



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

CERTIFICATE NO.: 2024010304677094

NAME AND ADDRESS OF THE APPLICANT

DELIXI ELECTRIC LTD

Delixi High Tech Industrial Park, Liushi Town, Yueqing City, Zhejiang Province, 325604, P.R.China

NAME AND ADDRESS OF THE MANUFACTURER

DELIXI ELECTRIC LTD

Delixi High Tech Industrial Park, Liushi Town, Yueqing City, Zhejiang Province, 325604, P.R.China

NAME AND LOCATION OF THE FACTORY

DELIXI ELECTRIC (WUHU) LTD

Wuhu Machinery Industrial Park, Wuhu City, Anhui Province, 241100, P.R.China

PRODUCT NAME,MODEL AND SPECIFICATION

AC Contactor

CJX2s-500、CJX2s-630 ; See the appendix

STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T 14048.4-2020

This is to certify that the above mentioned product(s) complies with the requirements of implementation rules for compulsory certification(REFNO. CNCA-C03-02:2024).

Valid from: Aug.16,2024

Valid until: Aug.15,2029

The certificate information and validity could be checked by scanning the QR code below or logging in to the website of the issuing authority, or on the website of the CNCA (www.cnca.gov.cn).



SIGNATURE:

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.





CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

CERTIFICATE NO. : 2024010304677094

Appendix: Page 1 of 2

CJX2s-500、CJX2s-630; Uimp: 8kV; Ui: 1000V; Ue: AC220V/230V, AC380V/400V,
AC660V/690V, AC1000V(Only AC-1); Ith: 630A, 700A;
CJX2s-500; Ith: 630A; AC-1: AC1000V/630A;
AC-3: Ue/Ie: AC220V/230V/500A,
AC380V/400V/500A, AC660V/690V/353A;
AC-4: Ue/Ie: AC220V/230V/175A,
AC380V/400V/175A, AC660V/690V/150A;
CJX2s-630; Ith: 700A; AC-1: AC1000V/700A;
AC-3: Ue/Ie: AC220V/230V/630A,
AC380V/400V/630A, AC660V/690V/400A;
AC-4: Ue/Ie: AC220V/230V/225A,
AC380V/400V/225A, AC660V/690V/200A;
Iq=50kA(AC400V); 50Hz/60Hz;
Us: AC/DC110V、AC/DC127V、AC/DC220V、
AC/DC220/230V、AC/DC240V、AC/DC380V、
AC/DC380/400V/(AC: 50Hz/60Hz), 3P; IP00(Main Circuit), IP20(Control、Auxiliary
Circuit);
Attached Auxiliary(FC4-11,
Certificate number : CQC2019010304179271): 1NO1NC; Ith: 10A;
Ui: 690V; AC-15: AC230V/3.13A, AC380V/1.89A, AC690V/1.04A; DC-13:
DC125V/0.55A, DC220V/0.31A

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO. : 2024010304677094

Appendix: Page 2 of 2

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation


Type description:

CJX 2s - □

AC-3 使用类别下 380V/400V 时的额定工作电流值

设计序号

交流接触器

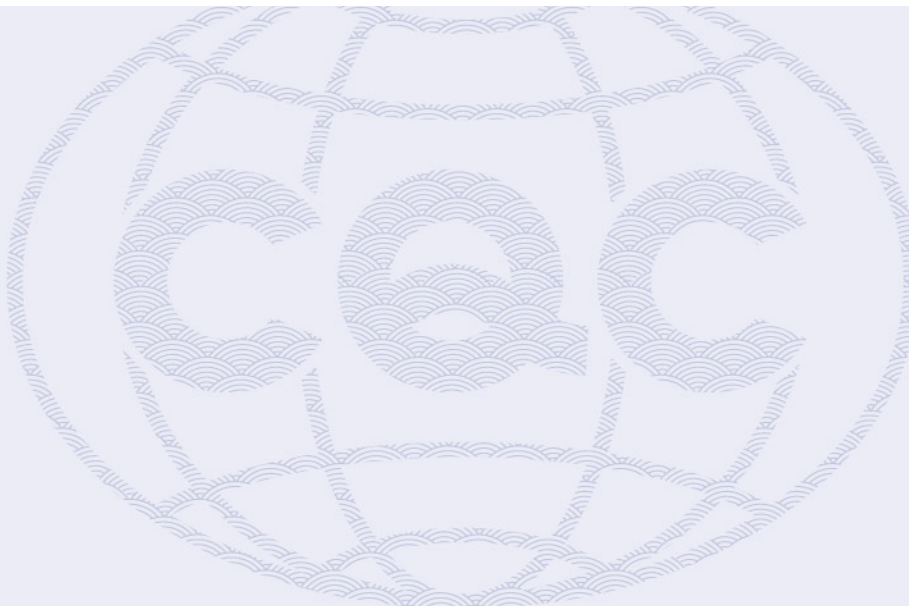

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.