



Test Report issued under the responsibility of:



TEST REPORT IEC 60947-6-1 Low-voltage switchgear and controlgear Part 6-1: Multiple function equipment – Transfer switching equipment	
Report Number.....	CN2668H8 001
Date of issue	07.04.2026
Total number of pages.....	108
Name of Testing Laboratory preparing the Report.....	Hunan Electric Research Institute Testing Group Co., Ltd.
Applicant's name	DELIXI ELECTRIC LTD
Address	Delixi High Tech Industrial Park, Liushi Town, Yueqing City, Zhejiang Province, China 325604
Test specification:	
Standard.....	IEC 60947-6-1:2021 for use in conjunction with IEC 60947-1:2020
Test procedure.....	CB Scheme
Non-standard test method.....	N/A
TRF template used.....	IECEE OD-2020-F1:2021, Ed.1.4
Test Report Form No.	IEC60947_6_1D
Test Report Form(s) Originator	SGS Fimko Ltd
Master TRF	Dated 2021-11-01
Copyright © 2021 IEC System of Conformity Assessment Schemes for Electrotechnical Equipment and Components (IECEE System). All rights reserved.	
This publication may be reproduced in whole or in part for non-commercial purposes as long as the IECEE is acknowledged as copyright owner and source of the material. IECEE takes no responsibility for and will not assume liability for damages resulting from the reader's interpretation of the reproduced material due to its placement and context.	
If this Test Report Form is used by non-IECEE members, the IECEE/IEC logo and the reference to the CB Scheme procedure shall be removed.	
This report is not valid as a CB Test Report unless signed by an approved IECEE Testing Laboratory and appended to a CB Test Certificate issued by an NCB in accordance with IECEE 02.	
General disclaimer:	
The test results presented in this report relate only to the object tested. This report shall not be reproduced, except in full, without the written approval of the Issuing NCB. The authenticity of this Test Report and its contents can be verified by contacting the NCB, responsible for this Test Report.	

Test item description..... :	Automatic Transfer Switching Equipment	
Trade Mark(s)..... :		
Manufacturer..... :	DELIXI ELECTRIC LTD	
Model/Type reference..... :	CDQ6i-100	
Ratings..... :	Ue: AC230V(2P), AC400V(3P/4P), 50, 50/60Hz; Class PC; AC-32B(type N), AC-33B(type H); 2P, 3P, 4P; Ui: 800V; Uimp: 8kV; Icm: 7,65kA; Icw: 5kA/30ms; Ie: 16A, 20A, 25A, 32A, 40A, 50A, 63A, 80A, 100A(type N); Ie: 16A, 20A, 25A, 32A, 40A, 50A, 63A(type H)	
Responsible Testing Laboratory (as applicable), testing procedure and testing location(s):		
☒	CB Testing Laboratory:	Hunan Electric Research Institute Testing Group Co., Ltd.
Testing location/ address.....:		199 Xinxiangxi Road, Kunlunqiao Subdistrict, Xiangxiang City Xiangtan City Hunan Province China
Tested by (name, function, signature).....:		Jiang Wu, Test Engineer 
Approved by (name, function, signature)....:		Bin Li, Approver 
☐	Testing procedure: CTF Stage 1:	
Testing location/ address.....:		
Tested by (name, function, signature).....:		
Approved by (name, function, signature)....:		
☐	Testing procedure: CTF Stage 2:	
Testing location/ address.....:		
Tested by (name + signature)		
Witnessed by (name, function, signature)...		
Approved by (name, function, signature)....:		
☐	Testing procedure: CTF Stage 3:	
☐	Testing procedure: CTF Stage 4:	
Testing location/ address.....:		
Tested by (name, function, signature).....:		
Witnessed by (name, function, signature)...		
Approved by (name, function, signature)....:		
Supervised by (name, function, signature) :		

List of Attachments (including a total number of pages in each attachment):

Attachment 1: Photo documentation – 5 pages (page 104-108)

Summary of testing:

There is no difference in the internal structure and material among the products with different rated current or different type(N/H) except the nameplates.

The controller models are divided into basic type, LED type and LCD type. The basic type is controlled by relay, and all electronic circuits are composed of passive components. LED type and LCD type have PCB.

2P and 3P have the same size, while 2P has one less pole than 3P. 3P and 4P have different length but the same width and height, with no difference between the poles.

The wiring methods include power top supply and bottom supply. The bottom supply method is represented by the D code. The product of bottom side is the power side I and power side II, and the top side is the load side, while the power top supply method is reverse. Other structure is identical.

All tests passed.

Tests performed (name of test and test clause):**Test sequence I: General performance characteristics**

- 9.2.3.1 Constructional requirements
- 9.2.3.2 Operation
- 9.2.3.3 Controls, sequence and limits of operation
- 9.2.3.4 Tripping limits and characteristics
- 9.2.3.5 Temperature-rise
- 9.2.3.6 Dielectric properties

Test sequence II: Operating performance capability

- 9.2.4.1 Making and breaking capacities
- 9.2.4.2 Operational performance capability
- 9.2.4.3 Verification of dielectric withstand
- 9.2.4.4 Verification of temperature-rise
- 9.2.4.5 Verification of overload releases
- 9.2.4.6 Verification of main contact position

Test sequence III: Short-circuit performance capability

- 9.2.5.1 General requirements
- 9.2.5.2 Short-time withstand current
- 9.2.5.3 Short-circuit making capacity
- 9.2.5.4 Short-circuit breaking capacity
- 9.2.5.5 Verification of dielectric withstand
- 9.2.5.6 Verification of temperature-rise

Test sequence VI: EMC

- 9.2.8 Electromagnetic compatibility

Testing location:

Zhejiang Testing and Inspection Institute for Mechanical and Electrical Products Quality
No. 125, Miaohouwang Road, Binjiang District, Hangzhou, Zhejiang, China.

Test sample	Test sequence
CDQ6i-100N/4PC, CDQ6i-100H/4PB, CDQ6i-100H/2P	Test sequence I
CDQ6i-100N/4PC, CDQ6i-100H/4PCD, CDQ6i-100H/2P	Test sequence II
CDQ6i-100/4PC, CDQ6i-100H/4PCD, CDQ6i-100H/2P	Test sequence III
CDQ6i-100N/4PC, CDQ6i-100H/4PB	Test sequence VI

Summary of compliance with National Differences (List of countries addressed):

☒ The product fulfils the requirements of EN IEC 60947-6-1:2023.

Copy of marking plate:



Test item particulars	
Type and characteristics of equipment	
- class of equipment.....	CDQ6i-100
- method of controlling	PC / CB / CC
- number of main contact positions.....	MTSE / RTSE / ATSE
- suitability for isolation	two positions / three positions
- transition type	suitable / not suitable
- number of poles	-
- neutral pole	2P, 3P, 4P
- kind of current.....	yes(for 4P) / no(for 3P/2P)
- in case of alternating current, number of phases and the rated frequency.....	AC / DC
- type of interlock	50Hz, 50/60Hz
- control functions.....	mechanical / electrical / electrical-and-mechanical
- contact transfer time (ms).....	-
- in case of RTSE or ATSE, operating transfer time	0,7s±10%
- in case of ATSE, operating sequences.....	Basic type: 1,6±10%; LED type: 2,2s±10%; LCD type: 3,25s±10%
- pollution degree	automatic transfer, automatic return or not return
- EMC environment	3
	B
Rated and limiting values for the main circuit	
- rated operational voltage Ue (V)	AC230V(2P), AC400V(3P/4P)
- rated insulation voltage Ui (V)	800V
- rated impulse withstand voltage Uimp (kV).....	8kV
- conventional free air thermal current Ith (A).....	100A
- conventional enclosed thermal current Ithe (A) ...	N/A
- rated operational current Ie (A).....	type N: 16A, 20A, 25A, 32A, 40A, 50A, 63A, 80A, 100A type H: 16A, 20A, 25A, 32A, 40A, 50A, 63A
- rated uninterrupted current Iu (A).....	N/A
- rated frequency (Hz).....	50, 50/60Hz
Short-circuit characteristics	
- rated short-time withstand current Icw (kA)	N/A
- rated short-circuit making capacity Icm (kA).....	5kA/30ms
- rated short-circuit breaking capacity Icn (kA)	7,65kA
- rated conditional short-circuit current Iq or Icc (kA).....	N/A
Utilization category	
	AC-32B(type N), AC-33B(type H)

Control circuits	:	
- type of current.....	:	AC / DĞ
- rated frequency or direct current.....	:	50Hz, 50/60Hz
- rated control circuit voltage U_c (V)	:	AC230V
- rated control circuit supply voltage U_s (V)	:	AC230V
- power consumption (W).....	:	-
ATS controller	:	
- monitored supply deviation	:	Voltage (undervoltage and overvoltage transfer except for basic type) / frequency (only for LCD type)
- voltage deviations.....	:	Undervoltage:187V; Overvoltage: 263V
- tolerance of the voltage deviations.....	:	$\pm 10\%$
- frequency deviations	:	50Hz: Under-frequency: 45Hz, Over-frequency: 55Hz; 60Hz: Under-frequency: 50Hz, Over-frequency: 65Hz;
- tolerance of the frequency deviations	:	$\pm 2\text{Hz}$
- time delays	:	0-90s(except for basic type)
	:	-
Auxiliary circuits	:	
- rated operational voltage (V).....	:	-
- rated frequency (Hz).....	:	-
- number of circuits.....	:	-
- number and kind of contact elements	:	-
	:	-
Motor operator supply circuits	:	
- rated operational voltage (V).....	:	-
- rated frequency (Hz).....	:	-
- kind of protective device.....	:	-

Possible test case verdicts: - test case does not apply to the test object..... : N/A - test object does meet the requirement..... : P (Pass) - test object does not meet the requirement..... : F (Fail)	
Testing Date of receipt of test item..... : 07.07.2025 Date (s) of performance of tests : 07.07.2025 to 26.10.2025	
General remarks: "(See Enclosure #)" refers to additional information appended to the report. "(See appended table)" refers to a table appended to the report. Throughout this report a ☒ comma / ☐ point is used as the decimal separator.	
Manufacturer's Declaration per sub-clause 4.2.5 of IEC60947-1:	
The application for obtaining a CB Test Certificate includes more than one factory location and a declaration from the Manufacturer stating that the sample(s) submitted for evaluation is (are) representative of the products from each factory has been provided.....:	☐ Yes ☒ Not applicable
When differences exist; they shall be identified in the General product information section.	
Name and address of factory (ies)..... : DELIXI ELECTRIC (WUHU) LTD / Wuhu Machinery Industrial Park, Wuhu city 241100 Anhui P.R. China	

General product information and other remarks:

Type Designation: CDQ6i-100

Rated Operational Voltage U_e : AC230V(2P), AC400V(3P/4P),

Rated Frequency: 50, 50/60Hz

Class of Equipment: PC

Rated Insulation Voltage U_i : 800V

Rated Impulse Withstand Voltage U_{imp} : 8kV

Conventional Free Air Thermal Current I_{th} : 100A

Rated Operational Current I_e : 16A, 20A, 25A, 32A, 40A, 50A, 63A, 80A, 100A (type N);
16A, 20A, 25A, 32A, 40A, 50A, 63A (type H)

Utilization Category: AC-32B(type N), AC-33B(type H)

Rated Short-time Withstand Current I_{cw} : 5kA/30ms

Rated short-circuit making capacity I_{cm} : 7,65kA

Type Explanation:

<u>CD</u>	<u>Q</u>	<u>6i</u> -	<u>100</u>	<u>H /</u>	<u>a</u>	<u>b</u>	<u>c</u>
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)

(1): Enterprise Code

(2): TSE

(3): Design Number

(4): Frame size(A)

(5): Utilization categories: AC-33B: H; AC-32B: N

(6): The number of poles

(7): Controller type: Basic type: Null; LED type: B; LCD type: C

(8): Power top supply: Null; Power bottom supply: D

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict

6	PRODUCT INFORMATION		
6.2	Marking		
	Visible; The marking on the product shall be visible to the operator after the product is installed		
1.1	Switching position, I – II or I – O – II	I – O – II	P
1.2	Suitability for isolation, where applicable, with the isolation function symbol according to IEC 60417-6169-1:2012-08		P
1.3	For RTSE or ATSE with off-load manual operations for maintenance purposes: "OFF- LOAD OPERATION ONLY, switch off all supply sources before operating manually"		N/A
	Marked; On equipment or nameplate		
2.1	Manufacturer's name or trademark	DELIXI ELECTRIC	P
2.2	Type designation or serial number	CDQ6i-100	P
2.3	"IEC 60947-6-1", indicating the product complies with this document	IEC 60947-6-1	P
2.4	Class of equipment (PC, CC, CB), method of controlling (MTSE, RTSE, ATSE) and transition type (open transition, closed transition)	Class PC	P
2.5	Rated operational voltage(s) (Ue)	AC230V(2P), AC400V(3P/4P)	P
2.6	Utilization categories and corresponding operational current(s) at the rated operational voltage	AC-32B(type N): 16A, 20A, 25A, 32A, 40A, 50A, 63A, 80A, 100A AC-33B(type H): 16A, 20A, 25A, 32A, 40A, 50A, 63A	P
2.7	Value of the rated frequency or the indication "DC" or the symbol  (IEC 60417-5031:2002-10)	50Hz, 50/60Hz	P
2.8	Rated short-time withstand current (Icw), if applicable	5kA/30ms	P
2.9	Rated short-circuit breaking capacities (Icn), if applicable		N/A
2.10	For ATSE and RTSE, rated control circuit supply voltage and frequency	230V, 50Hz, 50/60Hz	P
2.11	Rated impulse withstand voltage (Uimp)	8kV(main circuit), 2,5kV(control and auxiliary circuit)	P
2.12	Terminal designations and markings	4P: A, B, C, N; 3P: A, B, C; 2P: L, N	P
2.13	Degree of protection of enclosed equipment according to Annex C of IEC 60947-1:2020 if the degree of protection is different than IP00		N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
2.14	Identification of neutral pole terminals, if applicable	N	P
2.15	For TSE including parts with stored charge components according to 8.1.8, a warning notice shall be provided on the product		N/A
2.16	For TSE Class CB, reference temperature for non-compensated thermal releases, if different than 30 °C		N/A
2.17	For TSE Class CB, range of the current settings (Ir) of the adjustable overload releases		N/A
2.18	For TSE Class CB, range of the rated instantaneous short-circuit current setting (Ii), for adjustable releases		N/A
	Literature; In provided literature		
3.1	Type of interlock	Electrical and mechanical	P
3.2	Number of poles	2P, 3P, 4P	P
3.3	Rated short-circuit making capacities (Icm) for Class PC and Class CB, if applicable	7,65kA	P
3.4	Rated conditional short-circuit current (Iq or alternatively Icc) and associated SCPD, if applicable		N/A
3.5	Rated insulation voltage (Ui)	800V	P
3.6	Number of main contact positions	3	P
3.7	For RTSE and ATSE, operating limits of electromechanical devices operating the main circuit	AC230V, 50Hz,50/60Hz	P
3.8	For ATSE, monitored supply deviations and operating limits	See page 7	P
3.9	Auxiliary circuits characteristics		N/A
3.10	For ATSE, operating sequence	automatic transfer, automatic return or not return	P
3.11	Contact transfer time, operating transfer time and additional information including time delays with their position in the operating sequence, if any	See page 6	P
3.12	EMC Environment A or B	B	P
3.13	Conductor strip length		N/A
3.14	Maximum number of conductors which may be clamped	1	P
3.15	Conductor designation for non-universal screwless terminals		N/A
3.16	References of minimum mandatory component of the complete unit which are required for the TSE		P
3.17	Control functions		P
3.18	Wiring diagram		N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
3.19	Dedicated wiring accessories, if applicable		N/A
3.20	For TSE Class CB - tripping/time characteristic - temperature/current characteristic, if applicable		N/A
	All controls accessible to the operator shall be marked to indicate their function		P
6.3	Instructions for installation, operation and maintenance, decommissioning and dismantling		
	Subclause 6.3 of IEC 60947-1:2020 applies with the following additions;		
	The instructions shall also cover the dedicated wiring accessories, if applicable		P
	For TSE tested according to this document and delivered to the customer unassembled or partially assembled, the TSE manufacturer shall provide instructions for proper assembly, wiring, marking, any remaining routine tests as defined in 9.3, commissioning, operation and maintenance of the TSE.		P
	For sensing cables and bridging conductors not supplied with the TSE or not made available as a type tested accessory, the manufacturer shall provide instructions on how to fabricate.		P
	The operation manual of the TSE shall include the description of the operating sequences.		P
6.4	Environmental information		
	When required, material declarations shall be established according to Annex W of IEC 60947-1:2020.		N/A

7	NORMAL SERVICE, MOUNTING AND TRANSPORT CONDITIONS		
	Clause 7 of IEC 60947-1:2020 applies		
7.1	Normal service conditions		
7.1.1	Ambient air temperature		
	The ambient air temperature does not exceed +40 °C and its average over a period of 24 h does not exceed +35 °C. The lower limit of the ambient air temperature is –5 °C.		P
7.1.2	Altitude		
	The altitude of the site of installation does not exceed 2 000 m.		P
7.1.3	Atmospheric conditions		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
7.1.3.1	Humidity		P
7.1.3.2	Pollution degree		P
7.1.4	Shock and vibration		N/A
	Standard conditions of vibration are defined in footnote b of Table Q.1 of IEC 60947-1:2020		N/A
7.2	Conditions during transport and storage		
	Between –25 °C and +55 °C and, for short periods not exceeding 24 h, up to +70 °C		P
7.3	Mounting		
	The equipment shall be mounted in accordance with the manufacturer's instructions.		P
	Rail mounting shall be specified according to IEC 60715:2017, if applicable.		P

8	CONSTRUCTIONAL AND PERFORMANCE REQUIREMENTS		
8.1	Constructional requirements		
8.1.1	General Subclause 8.1 of IEC 60947-1:2020 applies with additions:		
	Where the product is intended to be used together with specific auxiliary equipment and dedicated wiring accessories, the safety evaluation and test shall include this auxiliary equipment and accessories unless it can be shown that it does not affect the safety of any equipment.		P
	The accessible part of the device and especially the operating means shall not present sharp edges and corners which can injure the operator.		P
	The minimum components which shall be verified by the manufacturer as a complete unit to achieve compliance as a TSE are defined in 5.2 item n):		P
	For sensing cables and bridging conductors not supplied with the TSE or not made available as a type tested accessory, the manufacturer shall provide instructions on how to fabricate.		P
	Where different ratings are declared for position I and position II, each position shall be tested.		N/A
	For CC class TSE, standard conditions of vibration are defined in footnote b of Table Q.1 of IEC 60947-1:2020.		N/A
8.1.2	Materials Subclause 8.1.2 of IEC 60947-1:2020 applies		
8.1.2.1	General material requirements		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Parts of insulating materials which might be exposed to thermal stresses due to electrical effects within the equipment shall not be adversely affected by abnormal heat and by fire.		P
	The manufacturer shall specify which test method, 8.1.2.2 or 8.1.2.3, is to be used		P
8.1.2.2	Glow wire testing		
	The suitability of materials used is verified by:		
	a) making tests on the equipment		N/A
	b) making tests on sections taken from the equipment		P
	c) making tests on any parts of identical material having representative thickness		N/A
	d) providing data from the insulating material supplier fulfilling the requirements according to IEC 60695-2-12.		N/A
	Glow-wire test according to IEC 60695-2-10 and IEC 60695-2-11		
	Parts made of insulating material necessary to retain current-carrying parts in position: test temperature 850 °C or 960 °C		
	Test temperature (°C).....: 960°C		P
	No visible flame and no sustained glowing		N/A
	Flames and glowing extinguish within 30 s		P
	No ignition of the tissue paper		P
	When tests on the equipment or on sections taken from the equipment are used, test temperature:		
	850 °C for class CC TSE		N/A
	No visible flame and no sustained glowing		N/A
	Flames and glowing extinguish within 30 s		N/A
	No ignition of the tissue paper		N/A
	960 °C for class CB TSE		N/A
	No visible flame and no sustained glowing		N/A
	Flames and glowing extinguish within 30 s		N/A
	No ignition of the tissue paper		N/A
	960 °C for class PC TSE		N/A
	No visible flame and no sustained glowing		N/A
	Flames and glowing extinguish within 30 s		N/A
	No ignition of the tissue paper		N/A
	Parts of insulating material not necessary to retain current-carrying parts in position, even though in contact with them: test temperature 650 °C		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	No visible flame and no sustained glowing		N/A
	Flames and glowing extinguish within 30 s		N/A
	No ignition of the tissue paper		N/A
8.1.2.3	Test based on flammability category		
	For parts of insulating materials, hot wire ignition and, where applicable, arc ignition tests as specified in 9.2.2.2, shall be made based on flammability category.		N/A
	Tests on materials are made in accordance with Annex M.		N/A
	The hot wire ignition (HWI) and arc ignition (AI) test value requirements related to the material flammability category shall conform to Table M.1 or M.2.		N/A
	Alternatively, the manufacturer may provide data from the insulating material supplier fulfilling the requirements given in Annex M.		N/A
8.1.3	Indication of the switching position		
	I (IEC 60417-5007:2002-10) for ON (source I)		P
	O (IEC 60417-5008:2002-10) for power OFF		P
	II (IEC 60417-6176:2012-11) for ON (source II)		P
8.1.4	Equipment suitable for isolation Subclauses 8.1.7 and 8.2.7 of IEC 60947-1:2020 applies		
8.1.7 part 1 and part 3	Additional requirements for equipment suitable for isolation		
8.1.7.1	Additional constructional requirements		
	- marking according to 5.2.1b		P
	- indication of the position of the contacts		P
	- construction of the actuating mechanism		P
	- minimum clearances across open contacts (see Table 13, Part 1) (mm)	8mm	—
	- measured clearances (mm)	16,6mm	P
	- test Uimp across gap (kV)	12,3kV	P
8.1.7.2	Supplementary requirements for equipment with provision for electrical interlocking with contactors or circuit-breakers		
	Auxiliary switch is rated according to IEC 60947-5-1 (unless the equipment is rated AC-23).		N/A
	Time interval between opening of the contacts of the auxiliary contact and the contacts of the main poles: ≥20 ms		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Measured time interval (ms)		N/A
	During the closing operation the contacts of the auxiliary switch closes after or simultaneously with the contacts of the main poles.		N/A
8.1.7.3	Supplementary requirements for equipment provided with means for padlocking the open position		
	The locking means is so designed that it cannot be removed with the appropriate padlock(s) installed.		N/A
	Test force F applied to the actuator in an attempt to operate to the closed position (N)		
	Rated impulse withstand voltage (kV)		
	Test Uimp on open main contacts at the test force		N/A
8.2.7 part 1	Leakage currents of equipment suitable for isolation		
	Equipment suitable for isolation, leakage current not exceed 0,5 mA		
	Test voltage 1,1 Ue (V).....	440V	P
	Measured leakage current (mA)	<0,01mA	P
8.1.5	Opening and closing of main contacts		
	The main moving contacts of all phase poles of the switching device of a multipole TSE shall be so mechanically coupled that they make and break substantially together, whether operated manually, remotely, or automatically.		P
	The manual actuator of the TSE shall be insulated. The requirements of 8.1.5.1 of IEC 60947-1:2020 applies.		P
8.1.5.1 part 1	Insulation		
	Actuator insulated from live parts for		
	- rated insulation voltage (V)	800V(main circuit), 250V(control and auxiliary circuit)	P
	- rated impulse withstand voltage (kV)	8kV(main circuit), 2,5kV(control and auxiliary circuit)	P
	Actuator made of metal		
	- connected to a protective conductor or provided with an additional reliable insulation		N/A
	Internal metal parts, which might become accessible in the event of an insulation failure, are also insulated from live parts for the rated insulation voltage.		N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	There shall be no path or opening which allows incandescent particles to be discharged from the area of the manual operating means.		P
	For TSE equipped with neutral poles, 8.1.9 of IEC 60947-1:2020 applies.		P
8.1.9 part 1	Additional requirements for equipment provided with a neutral pole		
	Equipment provided with a pole intended for the connection of neutral, this pole shall be clearly marked by the letter "N".	N	P
	The switched neutral pole does not break before and does not make after the other poles except		P
	- a pole having the appropriate short-circuit breaking and making capacity is used as neutral pole, all poles may operate together		N/A
	Conventional thermal current of neutral pole		P
	For any TSE with manual operating means intended for on-load use, opening and closing of the main contacts shall be independent of the speed with which the manual operating means is operated unless:		P
	Manual means is intended only for off-load use with all sources de-energized and is so marked according to Table 2 item 1.3.		P
8.1.6	Clearances and creepage distances Subclause 8.1.4 of IEC 60947-1:2020 applies		
8.1.4.1 part 1	General		
	Clearances:		
	- Uimp is given as:	8kV	
	- max. value of rated operational voltage to earth:	-	
	- nominal voltage of supply system:	-	
	- overvoltage category:	III	
	- pollution degree:	3	
	- field-in or homogeneous:		
	- minimum clearances (mm).....:	8mm	
	- measured clearances (mm)	see appended table 8.1.6	P
	Creepage distances:		
	- rated insulation voltage Ui (V)	800V	
	- pollution degree.....:	3	
	- comparative tracking index (V)	175V	
	- material group	IIIa	

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- minimum creepage distances (mm).....:	12,5mm	
	- measured creepage distances (mm)	see appended table 8.1.6	P
8.1.4.2 part 1	Insulation coordination barriers for creepage distances		
	When solid insulation is used as an insulation coordination barrier to comply with required creepage distances, the material used shall comply with the glow wire requirements in 8.1.2.2 or the flammability requirements in 8.1.2.3.		N/A
8.1.4.3 part 1	Insulation coordination barriers for clearance distances		
	When solid insulation is used as an insulation coordination barrier to comply with required clearance distances and does not physically support or maintain the relative position of uninsulated parts involved, the barrier material shall comply with the glow wire requirements in 8.1.2.2 and shall conform to the glow-wire test requirements of 9.2.2.1 at a temperature of 650 °C or the AI values in Table M.2. Or alternatively:		N/A
	The material shall comply with the requirements in 8.1.4.2.		N/A
	Where SELV and PELV circuits of the complete TSE are accessible, they shall be separated from other hazardous live-part according to the requirements of Annex N of IEC 60947-1:2020.		N/A
8.1.7	Provision for protective earthing Subclause 8.1.10 of IEC 60947-1:2020 applies		
8.1.10.1 part 1	Constructional requirements		
	The exposed conductive parts other than those which cannot constitute a danger shall be electrically interconnected and connected to a protective earth terminal for connection to an protective earthing conductor.		P
	This requirement can be met by the normal structural parts providing adequate electrical continuity and applies whether the equipment is used on its own or incorporated in an assembly.		P
	Exposed conductive parts are considered not to constitute a danger if they cannot be touched on large areas or grasped with the hand or if they are of small size (approximately 50 mm × 50 mm) or are so located as to exclude any contact with live parts.		N/A
8.1.10.2 part 1	Protective earth terminal		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	The protective earth terminal shall be readily accessible and so placed that the connection of the equipment to the protective earthing conductor is maintained when the cover or any other removable part is removed.		P
	The protective earth terminal shall be suitably protected against corrosion.		P
	In the case of equipment with conductive structures, enclosures, etc., means shall be provided, if necessary, to ensure electrical continuity between the exposed conductive parts of the equipment and the metal sheathing of connecting conductors.		N/A
	The protective earth terminal shall have no other function, except when it is intended to be connected to a PEN conductor, PEM conductor or PEL conductor. In this case, it shall also have the function of a neutral terminal, mid terminal or earthed line terminal in addition to meeting the requirements applicable to the protective earth terminal.		N/A
8.1.10.3 part 1	Protective earth terminal marking and identification		
	The identification shall be achieved by colour (green-yellow mark) or by the notation PE, PEN, PEM or PEL, as applicable, in accordance with 7.3 of IEC 60445:2017, or by a graphical symbol for use on equipment.		P
	The graphical symbol to be used is the symbol 60417-5019 (2006-08)  Protective earth (ground) in accordance with the IEC 60417 database.		P
8.1.10.4 part 1	Protective earth continuity		
	All exposed conductive parts of the equipment and/or its enclosure shall be effectively connected to the terminal for the incoming external protective conductor.		P
	The resistance of the circuit from the exposed conductive part to the protective earth terminal shall not exceed 0,1 Ω .		P
8.1.8	Stored charge energy circuit		
	Parts including stored charge (capacitors) that are removable for servicing (such as coil replacement), installation, or disconnection shall present no risk of electric energy hazard after disconnection.		N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Capacitors connected to accessible hazardous live parts shall be discharged to an energy level less than 0,5 mJ within 5 s after the removal of power. Otherwise:		N/A
	- readily visible warning notice shall be provided on the product, indicating the time of discharge to the limit values or		N/A
	- preferable method how to discharge the capacitor before touching the connecting parts		N/A
8.1.9	Stored energy closing		
	The stored energy closing mechanism shall be capable of ensuring the operation of TSE in any condition between no-load and its rated making capacity.		N/A
	When the stored energy is retained within the TSE, a device shall be provided which indicates when the storing mechanism is fully charged. A device shall also be provided to indicate when the storing mechanism is not charged sufficiently to allow operation. These charge indications shall be operational with and without the availability of electrical power.		N/A
	Means for charging the operating mechanism, as well as the closing control components, shall be capable of operating when the auxiliary supply voltage is between 85 % and 110 % of the rated control supply voltage.		N/A
	It shall not be possible for the moving contacts to move from the open position unless the charge is sufficient for satisfactory completion of the closing operation.		N/A
	When the energy storing mechanism is manually operated, the direction of operation shall be indicated. This requirement does not apply to TSE with an independent manual closing operation.		N/A
8.1.10	Dedicated enclosures for TSE Subclause 8.1.11 of IEC 60947-1:2020 applies		
8.1.11.1 part 1	Design		
	When the enclosure is opened, all parts requiring access for installation and maintenance are readily accessible.		P
	Sufficient space is provided inside the enclosure.		P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	The fixed parts of a metal enclosure are electrically connected to the other exposed conductive parts of the equipment and connected to a terminal which enables them to be earthed or connected to a protective conductor.		P
	Under no circumstances a removable metal part of the enclosure is insulated from the part carrying the earth terminal when the removable part is in place.		P
	The removable parts of the enclosure are firmly secured to the fixed parts by a device such that they cannot be accidentally loosened or detached owing to the effects of operation of the equipment or vibrations.		P
	When an enclosure is so designed as to allow the covers to be opened without the use of tools, means is provided to prevent loss of the fastening devices.		N/A
	If the enclosure is used for mounting push-buttons, it is not possible to remove the buttons from the outside of the enclosure.		N/A
8.1.11.2 part 1	Insulation		
	If, in order to prevent accidental contact between a metallic enclosure and live parts, the enclosure is partly or completely lined with insulating material, then this lining is securely fixed to the enclosure.		N/A
8.1.12 part 1	Degrees of protection of enclosed equipment		
	Degree of protection: IPXX		
	Test for first characteristic: IPXX		
	Test for first numeral (1, 2, 3, 4, 5, 6).....: N/A		
	Test for second characteristic: IPXX		
	Test for second numeral (1, 2, 3, 4, 5, 6, 7, 8, 9).....: N/A		
8.1.13 part 1	Conduit pull-out, torque and bending with metallic conduits		
	Polymeric enclosures of equipment, whether integral or not, provided with threaded conduit entries, intended for the connection of extra heavy duty, rigid threaded metal conduits complying with IEC 60981, shall withstand the stresses occurring during its installation such as pull-out, torque, bending.		N/A
	Compliance verified by the test of 9.2.8.		N/A
8.1.8 part 1	Terminals		
8.1.8.1	Constructional requirements		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	All parts of terminals which maintain contact and carry current shall be of metal having adequate mechanical strength.		P
	Terminal connections shall be such that the force to connect the conductors may be applied by screws, screwless-type or other equivalent means so as to ensure that the necessary contact pressure is maintained.		P
	Terminals shall be so constructed that the conductors can be clamped between suitable surfaces without any significant damage either to conductors or terminals.		P
	Terminals shall not allow the conductors to be displaced or be displaced themselves in a manner detrimental to the operation of equipment and the insulation voltage shall not be reduced below the rated values.		P
	If required by the application, terminals and conductors may be connected by means of cable lugs for copper conductors only (see Table P.1).		N/A
	Screwless-type clamping units, unless otherwise specified by the manufacturer, shall accept solid, stranded and flexible conductors as indicated in Table 1.		N/A
	On screwless-type clamping unit, the connection or disconnection of conductors shall be made as follows:		
	- on universal clamping units by the use of a general purpose tool or a convenient device, integral with the clamping unit to open it for the insertion or withdrawal of the conductors		N/A
	- on push-wire clamping units by simple insertion. For the disconnection of the conductors an operation other than a pull only on the conductor shall be necessary. The use of a general purpose tool or of a convenient device, integral with the clamping unit is allowed in order to "open" it and to assist the insertion or the withdrawal of the conductor.		N/A
8.1.8.2	Connecting capacity		
	Type of conductors.....: prepared conductor		
	Minimum cross-section of conductor (mm ²): 2,5		
	Maximum cross-section of conductor (mm ²).....: 35		
	Number of conductors simultaneously connectable to the terminal: 1		
8.1.8.3	Connection		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Terminals for connection to external conductors shall be readily accessible during installation.		P
	Clamping screws and nuts shall not serve to fix any other component although they may hold the terminals in place or prevent them from turning.		P
8.1.8.4	Terminal identification and marking		
	Terminals intended exclusively for the neutral conductor shall be identified by the letter "N".		P
	The protective earth terminal shall be identified in accordance with 8.1.10.3.		P
	Other terminals		N/A

9.2.3	TEST SEQUENCE I: GENERAL PERFORMANCE CHARACTERISTICS I-1, CDQ6i-100N/4PC		
9.2.3.1	Compliance with constructional requirements		
9.2.5 part 1	Mechanical and electrical properties of terminals		
9.2.5.2	Tests of mechanical strength of terminals		
	Maximum cross-section of conductor (mm ²).....:	35	
	Diameter of thread (mm).....:	M6	
	Torque (Nm).....:	1,1×3	
	5 times on 2 separate clamping units		P
	During the test, clamping units and terminals shall not work loose and there shall be no damage.		P
9.2.5.3	Testing for damage to and accidental loosening of conductor (flexion test)		
9.2.5.4	Pull-out test		
a)	Conductor of the minimum cross-section (mm ²).....:		
	Number of conductors of the minimum cross-section		
	Diameter of bushing hole (mm)		
	Height between the equipment and the platen		
	Mass at the conductor(s) (kg).....:		
	135 continuous revolutions: the conductor neither slips out of the terminal nor breaks near the clamping unit		N/A
	Pull-out test		
	Force (N), applied for 1 min.....:		
	During the test, the conductor neither slips out of the terminal nor breaks near the clamping unit.		N/A
b)	Conductor of the maximum cross-section (mm ²).....:		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Number of conductors of the maximum cross-section		
	Diameter of bushing hole (mm)		
	Height between the equipment and the platen		
	Mass at the conductor(s) (kg).....		
	135 continuous revolutions: the conductor neither slips out of the terminal nor breaks near the clamping unit		N/A
	Pull-out test		
	Force (N), applied for 1 min.....		
	During the test, the conductor neither slips out of the terminal nor breaks near the clamping unit.		N/A
c)	Conductor of the minimum and maximum cross-section (mm ²)		
	Number of conductors of the minimum cross-section, number of conductors of the maximum cross-section		
	Diameter of bushing hole (mm)		
	Height between the equipment and the platen		
	Mass at the conductor(s) (kg).....		
	135 continuous revolutions: the conductor neither slips out of the terminal nor breaks near the clamping unit		N/A
	Pull-out test		
	Force (N), applied for 1 min.....		
	During the test, the conductor neither slips out of the terminal nor breaks near the clamping unit.		N/A
9.2.5.7	Electrical performance of screwless-type clamping units		
	Subclauses 9.8 of IEC 60999-1:1999 and 9.8 of IEC 60999-2:2003 apply.	See Attachment XX	N/A
9.2.5.8	Ageing test for screwless-type clamping units		
	Subclauses 9.10 of IEC 60999-1:1999 and 9.10 of IEC 60999-2:2003 apply	See Attachment XX	N/A
9.2.8 part 1	Conduit pull-out test, torque test and bending test with metallic conduits		
9.2.8.2	Pull-out test		
	Torque (Nm).....		
	Force (N), applied for 5 min.....		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	After the test, the displacement of the conduit in relation with the entry shall be less than one thread depth and there shall be no evidence of damage impairing further use of the enclosure.		N/A
9.2.8.3	Bending test		
	Bending moment (Nm), applied for 1min.....:		
	After the test there shall be no evidence of damage impairing further use of the enclosure.		N/A
9.2.8.4	Torque test		
	Torque (Nm).....:		N/A
	After the test, it shall be possible to unscrew the conduit and there shall be no evidence of damage impairing further use of the enclosure.		N/A
9.2.9 part 1	Test of earth continuity for protective earth		
9.2.9.2	Earth continuity test		P
9.2.3.2	Operation		
9.2.3.2.1	General		
	The operating mechanism shall be mechanically and/or electrically interlocked to prevent simultaneous connection to both source I and source II supplies under all conditions at the limits given in subclause 8.2.1.2 of IEC 60947-1:2020.		P
	The TSE shall be operated in each position (I, II and O if applicable) and each position of the switching device contacts shall be verified by electrical continuity test.		P
	For Class CC TSE, the drop-out test requirements of 9.3.3.2.1 of IEC 60947-1:2020 shall be verified.	See Attachment XX	N/A
	Compliance to opening and closing of main contacts is checked by inspection and by manual test.		P
9.2.3.2.2	Interlocking function verification		
9.2.3.2.2.2	Manual operation		
	The test performed without any electrical power available.		P
	For TSE equipped with a single manual actuator:		
	When the actuator is moved from position I to position II, it shall be verified that the terminals of source I are disconnected from the load terminals before the source II terminals are connected to the load terminals. The test shall be repeated from position II to position I.		P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	For TSE equipped with distinct manual actuators for each source switching device. Following sequence shall be verified:		
a)	With source I switching device in closed position, it shall be verified that source II switching device cannot be manually switched to closed position;		N/A
b)	With source II switching device in closed position, it shall be verified that source I switching device cannot be manually switched to closed position;		N/A
c)	With source I and source II switching devices both in open position, it shall be verified that simultaneous closing operations do not result in the closure of both switching devices at any time.		N/A
9.2.3.2.2.3	Electrically controlled operation		
	Following tests made with control circuit supply voltage 85 % and 110 % of rated value.		P
	If the interlock of the TSE requires electrical power, the test shall be conducted with this power supply connected and disconnected.		P
	For TSE equipped of a single remote actuator:		
	When a remote order to transfer from position I to position II is applied, it shall be verified that the load terminals are disconnected from source I terminals before being connected to source II terminals. The test shall be repeated from position II to position I.		P
	For TSE equipped of distinct remote actuators for each switching device. Following sequence shall be verified:		
a)	With source I and source II switching devices in the open position, it shall be verified that giving the order to switch both switching devices to close simultaneously for 5 s does not result in the closure of both devices. This test is applicable only to RTSE and ATSE allowing to send simultaneous transfer orders to position I and position II.		N/A
b)	With source I switching device in closed position, it shall be verified that sending a remote closing order on source II switching device for 5 s does not result in the closure of both switching devices at any time.		N/A
c)	With source II switching device in closed position, it shall be verified that sending a remote closing order on source I switching device for 5 s does not result in the closure of both switching devices at any time.		N/A
9.2.3.2.3	Verification of the robustness of the interlock		
9.2.3.2.3.1	General		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	The test shall be conducted in both position I and position II of the TSE.		P
	If the construction of the TSE is such that there is no significant physical difference between position I and position II that would influence the test results, the tests can be done in either position I or II.		P
	If it can be determined that one position represents a more difficult case, the tests are only required to be done in that position.		N/A
	MTSE shall be tested using manual operation means.		N/A
	RTSE and ATSE shall be tested using remote operation means, and manual operation means if applicable.		N/A
9.2.3.2.3.2	Manual operation		
	The test performed without any electrical power available.		P
	- actuator type (fig.).....:		
	- actuating force from one position to another (N)....:	36,2N	
	- test force with blocked main contacts (N).....:	150N	
	- used method to keep the contact closed.....:	Welding	
	For TSE equipped with a single manual actuator:		
	Test force applied 10s in the direction to open the contacts previously fixed together and close the other source switching device.		P
	During and after the test, none of the main contacts of the other source switching device shall close whether temporarily or definitely.		P
	For TSE equipped with distinct manual actuators for each source switching device. Following sequence shall be verified:		
a)	Test force applied 10s in the direction to open the contacts previously fixed together.		N/A
b)	Other source switching device cannot be manually switched to the closed position.		N/A
	During and after the test, none of the main contacts of the other source switching device shall close whether temporarily or definitely.		N/A
9.2.3.2.3.3	Dependent power operation		
	RTSE and ATSE with dependent power operation the TSE shall be closed in position I.		N/A
	- used method to keep the contact closed.....:		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	If the interlock of the TSE requires electrical power, this power supply shall be disconnected.		N/A
	- 110% supply voltage to the power operator applied		N/A
	- three attempts to operate at 5min intervals		N/A
	During and after the test, none of the main contacts of the other source switching device shall close whether temporarily or definitely.		N/A
9.2.3.2.3.4	Independent power operation		
	RTSE and ATSE with independent power operation the TSE shall be closed in position I.		P
	- used method to keep the contact closed.....	Welding	
	If the interlock of the TSE requires electrical power, this power supply shall be disconnected.		N/A
	- stored energy of the power operator released (3 times).....		P
	During and after the test, none of the main contacts of the other source switching device shall close whether temporarily or definitely.		P
9.2.3.2.4	Verification of electrical interlock in case of individual failure		
	Applies when the equipment is equipped with only electrical interlock, or with only electrically driven mechanical interlock, and no mechanical interlock.		N/A
	Verification of 8.2.1.2 c) shall be performed using:		
	- FMEA according to IEC 60812 or		N/A
	- by simulating any possible individual failure		N/A
9.2.3.2.5	Verification of the contact transfer time		
	TSE having a single mechanical operating handle:		
	Handle operating speed 1 m/s $\pm$ 25%	1,09m/s	P
	Contact transfer time (ms).....	722ms	P
	TSE having mechanical operating means requiring multiple motions to complete the transfer:		
	Handle operating speed 1 m/s $\pm$ 25%		N/A
	Contact transfer time (ms).....		N/A
	ATSE or RTSE:		
	100% control circuit supply voltage.....		P
	Contact transfer time (ms).....	736ms	P
9.2.3.3.	Controls, sequence and limits of operation		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
9.2.3.3.2	Operation on loss of supply voltage		
	ATSE provided with adjustable time delay(s): Tested with minimum and maximum values.	0s-90s	P
	With one of the monitored phases of source I disconnected, for a duration shorter than the corresponding time-delay, the ATSE shall not transfer.		P
	With one of the monitored phases of source I disconnected, for a duration longer than the corresponding time-delay if applicable, the ATSE shall transfer to position II. Transfer time shall be within the limits specified by the manufacturer.		P
	With the source I phase reconnected, the ATSE shall either return to position I, if set to "automatic return" mode, or stay in position II if set to "non-automatic return" mode.		P
	Tested for each monitored source supply with each of the monitored source conductors disconnected in turn.	see appended table 9.2.3.3.2	P
9.2.3.3.3	Operation on deviation of source I supply characteristics		
	ATSE provided with adjustable time delay(s): Tested with minimum value.	0s	P
	ATSE provided with adjustable deviation limits: Tested with minimum and maximum values.	Undervoltage: 187V Overvoltage: 263V	P
	Declared supply characteristic monitored on each terminal of source I shall be altered in turn to the values and tolerances as stated by the manufacturer and then restored to the original value:		
	- for voltage limits	see appended table 9.2.3.3.3	P
	- for frequency limits	see appended table 9.2.3.3.3	P
	- by altering the supply characteristic on all the phases simultaneously and by restoring it to its original value	see appended table 9.2.3.3.3	P
	During each of the tests, the ATSE:		
	- shall not transfer to position II when the supply characteristic is reduced or increased, if applicable, to a value within the deviation limits		P
	- shall transfer to position II when the supply characteristic is reduced or increased, if applicable, to a value outside of the deviation limits		P
	- shall either return to position I when the supply characteristic is restored, if set to "automatic return" mode, or stay in position II if set to "non-automatic return" mode		P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
9.2.3.3.4	Operation on deviation of source II supply characteristics		
a)	For voltage supply deviation monitoring:		
	Transfer from position I to position II occurs within the source II voltage limits stated by the manufacturer:		
	- by increasing source II voltage starting from below the value stated by the manufacturer	see appended table 9.2.3.3.4	P
	- if overvoltage monitoring provided, by decreasing source II voltage starting from above the value stated by the manufacturer	see appended table 9.2.3.3.4	P
b)	For voltage and frequency deviation monitoring:		
1)	Transfer from position I to position II occurs within the frequency limits stated by the manufacturer.	see appended table 9.2.3.3.4	P
2)	Transfer from position I to position II occurs within the voltage limits stated by the manufacturer.	see appended table 9.2.3.3.4	P
3)	Transfer from position I to position II occurs within the frequency limits stated by the manufacturer.	see appended table 9.2.3.3.4	P
4)	Transfer from position I to position II occurs within the voltage limits stated by the manufacturer.	see appended table 9.2.3.3.4	P
9.2.3.3.5	Operation with in-phase transfer control function		
	If the ATSE is provided with deviation limits for in-phase voltage, frequency and phase angle, the test shall be made once with the limit set to the minimum value, and once with the limit set to the maximum value for adjustable units.		N/A
	When deviation limits are fixed, same tests shall be done within the specified limits.		N/A
	Transfer from one position to another occurs within the limits stated by the manufacturer.	see appended table 9.2.3.3.5	N/A
9.2.3.4	Tripping limits and characteristics		
	The tripping limits and characteristics of CB type TSE shall be verified according to 8.3.3.2 of IEC 60947-2:2016, IEC 60947-2:2016/AMD1:2019.	See Attachment XX	N/A
9.2.3.5	Temperature-rise		
	ambient temperature 10-40 °C	28,3°C	
	test enclosure W x H x D (mm x mm x mm)		
	material of enclosure		
	control circuit supply voltage (V)	110%Us	
	Main circuits, test conditions:		
	- rated operational current I _e (A)	100A	
	- conventional thermal current I _{th} (A)	100A	

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- conventional enclosed thermal current I_{the} (A)		
	- cable / busbar cross-section (mm ²) / length (mm)...	35mm ²	
	Tested position:	position I	
	Fuse-link details (fuse-combination units only):		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference.....		
	- rated current (A)		
	- power loss (W)		
	- rated breaking capacity (kA).....		
	Measured temperature-rise	see appended table 9.2.3.5	P
	Auxiliary circuits, test conditions:		
	- rated operation current (A)		
	- cable cross-section (mm ²).....		
	Measured temperature-rise	see appended table 9.2.3.5	N/A
9.2.3.6	Dielectric properties		
	Verification of impulse withstand voltage		
	Rated impulse withstand voltage (kV).....	8kV(main circuit); 2,5kV(control and auxiliary circuit)	
	- test U_{imp} main circuits (kV).....	see appended table 9.2.3.6 a)	P
	- test U_{imp} auxiliary circuits (kV).....	see appended table 9.2.3.6 a)	P
	- test U_{imp} control circuits (kV).....	see appended table 9.2.3.6 a)	P
	- test U_{imp} on open main contacts (equipment suitable for isolation) (kV).....	see appended table 9.2.3.6 a)	P
	Power-frequency or DC withstand verification		
	- rated insulation voltage U_i (V)	800V(main circuit); 250V(control and auxiliary circuit)	P
	- main circuits, test voltage for 1 min. (V)	see appended table 9.2.3.6 b)	P
	- auxiliary circuits, test voltage for 1 min (V)	see appended table 9.2.3.6 b)	P
	- control circuits, test voltage for 1 min (V)	see appended table 9.2.3.6 b)	P
	Devices, which have been disconnected for the power-frequency withstand voltage test		P
	Equipment suitable for isolation, leakage current not exceed 0,5 mA		
	Test voltage 1,1 U_e (V).....	440V	P
	Measured leakage current (mA)	<0,01mA	P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict

9.2.3	TEST SEQUENCE I: GENERAL PERFORMANCE CHARACTERISTICS I-2, CDQ6i-100H/4PB, 4P, 100A		
9.2.3.1	Compliance with constructional requirements		
9.2.5 part 1	Mechanical and electrical properties of terminals		
9.2.5.2	Tests of mechanical strength of terminals		
	Maximum cross-section of conductor (mm ²).....:	35	
	Diameter of thread (mm).....:	M6	
	Torque (Nm).....:	1,1×3	
	5 times on 2 separate clamping units		P
	During the test, clamping units and terminals shall not work loose and there shall be no damage.		P
9.2.5.3	Testing for damage to and accidental loosening of conductor (flexion test)		
9.2.5.4	Pull-out test		
a)	Conductor of the minimum cross-section (mm ²).....:		
	Number of conductors of the minimum cross-section		
	Diameter of bushing hole (mm)		
	Height between the equipment and the platen		
	Mass at the conductor(s) (kg).....:		
	135 continuous revolutions: the conductor neither slips out of the terminal nor breaks near the clamping unit		N/A
	Pull-out test		
	Force (N), applied for 1 min.....:		
	During the test, the conductor neither slips out of the terminal nor breaks near the clamping unit.		N/A
b)	Conductor of the maximum cross-section (mm ²).....:		
	Number of conductors of the maximum cross-section		
	Diameter of bushing hole (mm)		
	Height between the equipment and the platen		
	Mass at the conductor(s) (kg).....:		
	135 continuous revolutions: the conductor neither slips out of the terminal nor breaks near the clamping unit		N/A
	Pull-out test		
	Force (N), applied for 1 min.....:		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	During the test, the conductor neither slips out of the terminal nor breaks near the clamping unit.		N/A
c)	Conductor of the minimum and maximum cross-section (mm ²)		
	Number of conductors of the minimum cross-section, number of conductors of the maximum cross-section		
	Diameter of bushing hole (mm)		
	Height between the equipment and the platen		
	Mass at the conductor(s) (kg).....		
	135 continuous revolutions: the conductor neither slips out of the terminal nor breaks near the clamping unit		N/A
	Pull-out test		
	Force (N), applied for 1 min.....		
	During the test, the conductor neither slips out of the terminal nor breaks near the clamping unit.		N/A
9.2.5.7	Electrical performance of screwless-type clamping units		
	Subclauses 9.8 of IEC 60999-1:1999 and 9.8 of IEC 60999-2:2003 apply.	See Attachment XX	N/A
9.2.5.8	Ageing test for screwless-type clamping units		
	Subclauses 9.10 of IEC 60999-1:1999 and 9.10 of IEC 60999-2:2003 apply	See Attachment XX	N/A
9.2.8 part 1	Conduit pull-out test, torque test and bending test with metallic conduits		
9.2.8.2	Pull-out test		
	Torque (Nm).....		
	Force (N), applied for 5 min.....		
	After the test, the displacement of the conduit in relation with the entry shall be less than one thread depth and there shall be no evidence of damage impairing further use of the enclosure.		N/A
9.2.8.3	Bending test		
	Bending moment (Nm), applied for 1min.....		
	After the test there shall be no evidence of damage impairing further use of the enclosure.		N/A
9.2.8.4	Torque test		
	Torque (Nm).....		N/A
	After the test, it shall be possible to unscrew the conduit and there shall be no evidence of damage impairing further use of the enclosure.		N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
9.2.9 part 1	Test of earth continuity for protective earth		
9.2.9.2	Earth continuity test		P
9.2.3.2	Operation		
9.2.3.2.1	General		
	The operating mechanism shall be mechanically and/or electrically interlocked to prevent simultaneous connection to both source I and source II supplies under all conditions at the limits given in subclause 8.2.1.2 of IEC 60947-1:2020.		P
	The TSE shall be operated in each position (I, II and O if applicable) and each position of the switching device contacts shall be verified by electrical continuity test.		P
	For Class CC TSE, the drop-out test requirements of 9.3.3.2.1 of IEC 60947-1:2020 shall be verified.	See Attachment XX	N/A
	Compliance to opening and closing of main contacts is checked by inspection and by manual test.		P
9.2.3.2.2	Interlocking function verification		
9.2.3.2.2.2	Manual operation		
	The test performed without any electrical power available.		P
	For TSE equipped with a single manual actuator:		
	When the actuator is moved from position I to position II, it shall be verified that the terminals of source I are disconnected from the load terminals before the source II terminals are connected to the load terminals. The test shall be repeated from position II to position I.		P
	For TSE equipped with distinct manual actuators for each source switching device. Following sequence shall be verified:		
a)	With source I switching device in closed position, it shall be verified that source II switching device cannot be manually switched to closed position;		N/A
b)	With source II switching device in closed position, it shall be verified that source I switching device cannot be manually switched to closed position;		N/A
c)	With source I and source II switching devices both in open position, it shall be verified that simultaneous closing operations do not result in the closure of both switching devices at any time.		N/A
9.2.3.2.2.3	Electrically controlled operation		
	Following tests made with control circuit supply voltage 85 % and 110 % of rated value.		P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	If the interlock of the TSE requires electrical power, the test shall be conducted with this power supply connected and disconnected.		P
	For TSE equipped of a single remote actuator:		
	When a remote order to transfer from position I to position II is applied, it shall be verified that the load terminals are disconnected from source I terminals before being connected to source II terminals. The test shall be repeated from position II to position I.		P
	For TSE equipped of distinct remote actuators for each switching device. Following sequence shall be verified:		
a)	With source I and source II switching devices in the open position, it shall be verified that giving the order to switch both switching devices to close simultaneously for 5 s does not result in the closure of both devices. This test is applicable only to RTSE and ATSE allowing to send simultaneous transfer orders to position I and position II.		N/A
b)	With source I switching device in closed position, it shall be verified that sending a remote closing order on source II switching device for 5 s does not result in the closure of both switching devices at any time.		N/A
c)	With source II switching device in closed position, it shall be verified that sending a remote closing order on source I switching device for 5 s does not result in the closure of both switching devices at any time.		N/A
9.2.3.2.3	Verification of the robustness of the interlock		
9.2.3.2.3.1	General		
	The test shall be conducted in both position I and position II of the TSE.		P
	If the construction of the TSE is such that there is no significant physical difference between position I and position II that would influence the test results, the tests can be done in either position I or II.		P
	If it can be determined that one position represents a more difficult case, the tests are only required to be done in that position.		N/A
	MTSE shall be tested using manual operation means.		N/A
	RTSE and ATSE shall be tested using remote operation means, and manual operation means if applicable.		N/A
9.2.3.2.3.2	Manual operation		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	The test performed without any electrical power available.		P
	- actuator type (fig.).....:		
	- actuating force from one position to another (N).....:	34,2N	
	- test force with blocked main contacts (N).....:	150N	
	- used method to keep the contact closed.....:	Welding	
	For TSE equipped with a single manual actuator:		
	Test force applied 10s in the direction to open the contacts previously fixed together and close the other source switching device.		P
	During and after the test, none of the main contacts of the other source switching device shall close whether temporarily or definitely.		P
	For TSE equipped with distinct manual actuators for each source switching device. Following sequence shall be verified:		
a)	Test force applied 10s in the direction to open the contacts previously fixed together.		N/A
b)	Other source switching device cannot be manually switched to the closed position.		N/A
	During and after the test, none of the main contacts of the other source switching device shall close whether temporarily or definitely.		N/A
9.2.3.2.3.3	Dependent power operation		
	RTSE and ATSE with dependent power operation the TSE shall be closed in position I.		N/A
	- used method to keep the contact closed.....:		
	If the interlock of the TSE requires electrical power, this power supply shall be disconnected.		N/A
	- 110% supply voltage to the power operator applied		N/A
	- three attempts to operate at 5min intervals		N/A
	During and after the test, none of the main contacts of the other source switching device shall close whether temporarily or definitely.		N/A
9.2.3.2.3.4	Independent power operation		
	RTSE and ATSE with independent power operation the TSE shall be closed in position I.		P
	- used method to keep the contact closed.....:	Welding	
	If the interlock of the TSE requires electrical power, this power supply shall be disconnected.		N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- stored energy of the power operator released (3 times).....:		P
	During and after the test, none of the main contacts of the other source switching device shall close whether temporarily or definitely.		P
9.2.3.2.4	Verification of electrical interlock in case of individual failure		
	Applies when the equipment is equipped with only electrical interlock, or with only electrically driven mechanical interlock, and no mechanical interlock.		N/A
	Verification of 8.2.1.2 c) shall be performed using:		
	- FMEA according to IEC 60812 or		N/A
	- by simulating any possible individual failure:		N/A
9.2.3.2.5	Verification of the contact transfer time		
	TSE having a single mechanical operating handle:		
	Handle operating speed 1 m/s $\pm$ 25%	1,09m/s	P
	Contact transfer time (ms).....:	721ms	P
	TSE having mechanical operating means requiring multiple motions to complete the transfer:		
	Handle operating speed 1 m/s $\pm$ 25%		N/A
	Contact transfer time (ms).....:		N/A
	ATSE or RTSE:		
	100% control circuit supply voltage.....:		P
	Contact transfer time (ms).....:	739ms	P
9.2.3.3.	Controls, sequence and limits of operation		
9.2.3.3.2	Operation on loss of supply voltage		
	ATSE provided with adjustable time delay(s): Tested with minimum and maximum values.	0s-90s	P
	With one of the monitored phases of source I disconnected, for a duration shorter than the corresponding time-delay, the ATSE shall not transfer.		P
	With one of the monitored phases of source I disconnected, for a duration longer than the corresponding time-delay if applicable, the ATSE shall transfer to position II. Transfer time shall be within the limits specified by the manufacturer.		P
	With the source I phase reconnected, the ATSE shall either return to position I, if set to "automatic return" mode, or stay in position II if set to "non-automatic return" mode.		P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Tested for each monitored source supply with each of the monitored source conductors disconnected in turn.	see appended table 9.2.3.3.2	P
9.2.3.3.3	Operation on deviation of source I supply characteristics		
	ATSE provided with adjustable time delay(s): Tested with minimum value.	0s	P
	ATSE provided with adjustable deviation limits: Tested with minimum and maximum values.	Undervoltage: 187V Overvoltage: 263V	P
	Declared supply characteristic monitored on each terminal of source I shall be altered in turn to the values and tolerances as stated by the manufacturer and then restored to the original value:		
	- for voltage limits	see appended table 9.2.3.3.3	P
	- for frequency limits	see appended table 9.2.3.3.3	N/A
	- by altering the supply characteristic on all the phases simultaneously and by restoring it to its original value	see appended table 9.2.3.3.3	P
	During each of the tests, the ATSE:		
	- shall not transfer to position II when the supply characteristic is reduced or increased, if applicable, to a value within the deviation limits		P
	- shall transfer to position II when the supply characteristic is reduced or increased, if applicable, to a value outside of the deviation limits		P
	- shall either return to position I when the supply characteristic is restored, if set to "automatic return" mode, or stay in position II if set to "non-automatic return" mode		P
9.2.3.3.4	Operation on deviation of source II supply characteristics		
	a) For voltage supply deviation monitoring:		
	Transfer from position I to position II occurs within the source II voltage limits stated by the manufacturer:		
	- by increasing source II voltage starting from below the value stated by the manufacturer	see appended table 9.2.3.3.4	P
	- if overvoltage monitoring provided, by decreasing source II voltage starting from above the value stated by the manufacturer	see appended table 9.2.3.3.4	P
	b) For voltage and frequency deviation monitoring:		
	1) Transfer from position I to position II occurs within the frequency limits stated by the manufacturer.	see appended table 9.2.3.3.4	N/A
	2) Transfer from position I to position II occurs within the voltage limits stated by the manufacturer.	see appended table 9.2.3.3.4	N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
3)	Transfer from position I to position II occurs within the frequency limits stated by the manufacturer.	see appended table 9.2.3.3.4	N/A
4)	Transfer from position I to position II occurs within the voltage limits stated by the manufacturer.	see appended table 9.2.3.3.4	N/A
9.2.3.3.5	Operation with in-phase transfer control function		
	If the ATSE is provided with deviation limits for in-phase voltage, frequency and phase angle, the test shall be made once with the limit set to the minimum value, and once with the limit set to the maximum value for adjustable units.		N/A
	When deviation limits are fixed, same tests shall be done within the specified limits.		N/A
	Transfer from one position to another occurs within the limits stated by the manufacturer.	see appended table 9.2.3.3.5	N/A
9.2.3.4	Tripping limits and characteristics		
	The tripping limits and characteristics of CB type TSE shall be verified according to 8.3.3.2 of IEC 60947-2:2016, IEC 60947-2:2016/AMD1:2019.	See Attachment XX	N/A
9.2.3.5	Temperature-rise		
	ambient temperature 10-40 °C	24,3°C	
	test enclosure W x H x D (mm x mm x mm)		
	material of enclosure		
	control circuit supply voltage (V)	110%Us	
	Main circuits, test conditions:		
	- rated operational current I _e (A)	100A	
	- conventional thermal current I _{th} (A)	100A	
	- conventional enclosed thermal current I _{the} (A)		
	- cable / busbar cross-section (mm ²) / length (mm) ..	35mm ²	
	Tested position:	position I	
	Fuse-link details (fuse-combination units only):		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference		
	- rated current (A)		
	- power loss (W)		
	- rated breaking capacity (kA)		
	Measured temperature-rise	see appended table 9.2.3.5	P
	Auxiliary circuits, test conditions:		
	- rated operation current (A)		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- cable cross-section (mm ²).....:		
	Measured temperature-rise.....:	see appended table 9.2.3.5	N/A
9.2.3.6	Dielectric properties		
	Verification of impulse withstand voltage		
	Rated impulse withstand voltage (kV).....:	8kV(main circuit); 2,5kV(control and auxiliary circuit)	
	- test Uimp main circuits (kV).....:	see appended table 9.2.3.6 a)	P
	- test Uimp auxiliary circuits (kV).....:	see appended table 9.2.3.6 a)	P
	- test Uimp control circuits (kV).....:	see appended table 9.2.3.6 a)	P
	- test Uimp on open main contacts (equipment suitable for isolation) (kV).....:	see appended table 9.2.3.6 a)	P
	Power-frequency or DC withstand verification		
	- rated insulation voltage Ui (V)	800V(main circuit); 250V(control and auxiliary circuit)	P
	- main circuits, test voltage for 1 min. (V)	see appended table 9.2.3.6 b)	P
	- auxiliary circuits, test voltage for 1 min (V)	see appended table 9.2.3.6 b)	P
	- control circuits, test voltage for 1 min (V)	see appended table 9.2.3.6 b)	P
	Devices, which have been disconnected for the power-frequency withstand voltage test.....:		P
	Equipment suitable for isolation, leakage current not exceed 0,5 mA		
	Test voltage 1,1 Ue (V).....:	440V	P
	Measured leakage current (mA)	<0,01mA	P

9.2.3	TEST SEQUENCE I: GENERAL PERFORMANCE CHARACTERISTICS I-3, CDQ6i-100H/2P, 2P, 100A		
9.2.3.1	Compliance with constructional requirements		
9.2.5 part 1	Mechanical and electrical properties of terminals		
9.2.5.2	Tests of mechanical strength of terminals		
	Maximum cross-section of conductor (mm ²).....:	35	
	Diameter of thread (mm).....:	M6	
	Torque (Nm).....:	1,1×3	
	5 times on 2 separate clamping units		P
	During the test, clamping units and terminals shall not work loose and there shall be no damage.		P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
9.2.5.3	Testing for damage to and accidental loosening of conductor (flexion test)		
9.2.5.4	Pull-out test		
a)	Conductor of the minimum cross-section (mm ²) :		
	Number of conductors of the minimum cross-section :		
	Diameter of bushing hole (mm) :		
	Height between the equipment and the platen :		
	Mass at the conductor(s) (kg)..... :		
	135 continuous revolutions: the conductor neither slips out of the terminal nor breaks near the clamping unit		N/A
	Pull-out test		
	Force (N), applied for 1 min..... :		
	During the test, the conductor neither slips out of the terminal nor breaks near the clamping unit.		N/A
b)	Conductor of the maximum cross-section (mm ²) :		
	Number of conductors of the maximum cross-section :		
	Diameter of bushing hole (mm) :		
	Height between the equipment and the platen :		
	Mass at the conductor(s) (kg)..... :		
	135 continuous revolutions: the conductor neither slips out of the terminal nor breaks near the clamping unit		N/A
	Pull-out test		
	Force (N), applied for 1 min..... :		
	During the test, the conductor neither slips out of the terminal nor breaks near the clamping unit.		N/A
c)	Conductor of the minimum and maximum cross-section (mm ²) :		
	Number of conductors of the minimum cross-section, number of conductors of the maximum cross-section :		
	Diameter of bushing hole (mm) :		
	Height between the equipment and the platen :		
	Mass at the conductor(s) (kg)..... :		
	135 continuous revolutions: the conductor neither slips out of the terminal nor breaks near the clamping unit		N/A
	Pull-out test		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Force (N), applied for 1 min.....:		
	During the test, the conductor neither slips out of the terminal nor breaks near the clamping unit.		N/A
9.2.5.7	Electrical performance of screwless-type clamping units		
	Subclauses 9.8 of IEC 60999-1:1999 and 9.8 of IEC 60999-2:2003 apply.	See Attachment XX	N/A
9.2.5.8	Ageing test for screwless-type clamping units		
	Subclauses 9.10 of IEC 60999-1:1999 and 9.10 of IEC 60999-2:2003 apply	See Attachment XX	N/A
9.2.8 part 1	Conduit pull-out test, torque test and bending test with metallic conduits		
9.2.8.2	Pull-out test		
	Torque (Nm).....:		
	Force (N), applied for 5 min.....:		
	After the test, the displacement of the conduit in relation with the entry shall be less than one thread depth and there shall be no evidence of damage impairing further use of the enclosure.		N/A
9.2.8.3	Bending test		
	Bending moment (Nm), applied for 1min.....:		
	After the test there shall be no evidence of damage impairing further use of the enclosure.		N/A
9.2.8.4	Torque test		
	Torque (Nm).....:		N/A
	After the test, it shall be possible to unscrew the conduit and there shall be no evidence of damage impairing further use of the enclosure.		N/A
9.2.9 part 1	Test of earth continuity for protective earth		
9.2.9.2	Earth continuity test		P
9.2.3.2	Operation		
9.2.3.2.1	General		
	The operating mechanism shall be mechanically and/or electrically interlocked to prevent simultaneous connection to both source I and source II supplies under all conditions at the limits given in subclause 8.2.1.2 of IEC 60947-1:2020.		P
	The TSE shall be operated in each position (I, II and O if applicable) and each position of the switching device contacts shall be verified by electrical continuity test.		P
	For Class CC TSE, the drop-out test requirements of 9.3.3.2.1 of IEC 60947-1:2020 shall be verified.	See Attachment XX	N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Compliance to opening and closing of main contacts is checked by inspection and by manual test.		P
9.2.3.2.2	Interlocking function verification		
9.2.3.2.2.2	Manual operation		
	The test performed without any electrical power available.		P
	For TSE equipped with a single manual actuator:		
	When the actuator is moved from position I to position II, it shall be verified that the terminals of source I are disconnected from the load terminals before the source II terminals are connected to the load terminals. The test shall be repeated from position II to position I.		P
	For TSE equipped with distinct manual actuators for each source switching device. Following sequence shall be verified:		
a)	With source I switching device in closed position, it shall be verified that source II switching device cannot be manually switched to closed position;		N/A
b)	With source II switching device in closed position, it shall be verified that source I switching device cannot be manually switched to closed position;		N/A
c)	With source I and source II switching devices both in open position, it shall be verified that simultaneous closing operations do not result in the closure of both switching devices at any time.		N/A
9.2.3.2.2.3	Electrically controlled operation		
	Following tests made with control circuit supply voltage 85 % and 110 % of rated value.		N/A
	If the interlock of the TSE requires electrical power, the test shall be conducted with this power supply connected and disconnected.		N/A
	For TSE equipped of a single remote actuator:		
	When a remote order to transfer from position I to position II is applied, it shall be verified that the load terminals are disconnected from source I terminals before being connected to source II terminals. The test shall be repeated from position II to position I.		N/A
	For TSE equipped of distinct remote actuators for each switching device. Following sequence shall be verified:		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
a)	With source I and source II switching devices in the open position, it shall be verified that giving the order to switch both switching devices to close simultaneously for 5 s does not result in the closure of both devices. This test is applicable only to RTSE and ATSE allowing to send simultaneous transfer orders to position I and position II.		N/A
b)	With source I switching device in closed position, it shall be verified that sending a remote closing order on source II switching device for 5 s does not result in the closure of both switching devices at any time.		N/A
c)	With source II switching device in closed position, it shall be verified that sending a remote closing order on source I switching device for 5 s does not result in the closure of both switching devices at any time.		N/A
9.2.3.2.3	Verification of the robustness of the interlock		
9.2.3.2.3.1	General		
	The test shall be conducted in both position I and position II of the TSE.		P
	If the construction of the TSE is such that there is no significant physical difference between position I and position II that would influence the test results, the tests can be done in either position I or II.		P
	If it can be determined that one position represents a more difficult case, the tests are only required to be done in that position.		N/A
	MTSE shall be tested using manual operation means.		N/A
	RTSE and ATSE shall be tested using remote operation means, and manual operation means if applicable.		N/A
9.2.3.2.3.2	Manual operation		
	The test performed without any electrical power available.		P
	- actuator type (fig.).....:		
	- actuating force from one position to another (N)....:	32,6N	
	- test force with blocked main contacts (N).....:	150N	
	- used method to keep the contact closed.....:	Welding	
	For TSE equipped with a single manual actuator:		
	Test force applied 10s in the direction to open the contacts previously fixed together and close the other source switching device.		P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	During and after the test, none of the main contacts of the other source switching device shall close whether temporarily or definitely.		P
	For TSE equipped with distinct manual actuators for each source switching device. Following sequence shall be verified:		
a)	Test force applied 10s in the direction to open the contacts previously fixed together.		N/A
b)	Other source switching device cannot be manually switched to the closed position.		N/A
	During and after the test, none of the main contacts of the other source switching device shall close whether temporarily or definitely.		N/A
9.2.3.2.3.3	Dependent power operation		
	RTSE and ATSE with dependent power operation the TSE shall be closed in position I.		N/A
	- used method to keep the contact closed.....:		
	If the interlock of the TSE requires electrical power, this power supply shall be disconnected.		N/A
	- 110% supply voltage to the power operator applied		N/A
	- three attempts to operate at 5min intervals		N/A
	During and after the test, none of the main contacts of the other source switching device shall close whether temporarily or definitely.		N/A
9.2.3.2.3.4	Independent power operation		
	RTSE and ATSE with independent power operation the TSE shall be closed in position I.		P
	- used method to keep the contact closed.....:	Welding	
	If the interlock of the TSE requires electrical power, this power supply shall be disconnected.		N/A
	- stored energy of the power operator released (3 times).....:		P
	During and after the test, none of the main contacts of the other source switching device shall close whether temporarily or definitely.		P
9.2.3.2.4	Verification of electrical interlock in case of individual failure		
	Applies when the equipment is equipped with only electrical interlock, or with only electrically driven mechanical interlock, and no mechanical interlock.		N/A
	Verification of 8.2.1.2 c) shall be performed using:		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- FMEA according to IEC 60812 or		N/A
	- by simulating any possible individual failure		N/A
9.2.3.2.5	Verification of the contact transfer time		
	TSE having a single mechanical operating handle:		
	Handle operating speed 1 m/s $\pm$ 25%	1,09m/s	P
	Contact transfer time (ms).....:	725ms	P
	TSE having mechanical operating means requiring multiple motions to complete the transfer:		
	Handle operating speed 1 m/s $\pm$ 25%		N/A
	Contact transfer time (ms).....:		N/A
	ATSE or RTSE:		
	100% control circuit supply voltage.....:		P
	Contact transfer time (ms).....:	740ms	P
9.2.3.3.	Controls, sequence and limits of operation		
9.2.3.3.2	Operation on loss of supply voltage		
	ATSE provided with adjustable time delay(s): Tested with minimum and maximum values.		N/A
	With one of the monitored phases of source I disconnected, for a duration shorter than the corresponding time-delay, the ATSE shall not transfer.		P
	With one of the monitored phases of source I disconnected, for a duration longer than the corresponding time-delay if applicable, the ATSE shall transfer to position II. Transfer time shall be within the limits specified by the manufacturer.		P
	With the source I phase reconnected, the ATSE shall either return to position I, if set to "automatic return" mode, or stay in position II if set to "non-automatic return" mode.		P
	Tested for each monitored source supply with each of the monitored source conductors disconnected in turn.	see appended table 9.2.3.3.2	P
9.2.3.3.3	Operation on deviation of source I supply characteristics		
	ATSE provided with adjustable time delay(s): Tested with minimum value.		N/A
	ATSE provided with adjustable deviation limits: Tested with minimum and maximum values.		N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Declared supply characteristic monitored on each terminal of source I shall be altered in turn to the values and tolerances as stated by the manufacturer and then restored to the original value:		
	- for voltage limits	see appended table 9.2.3.3.3	N/A
	- for frequency limits	see appended table 9.2.3.3.3	N/A
	- by altering the supply characteristic on all the phases simultaneously and by restoring it to its original value	see appended table 9.2.3.3.3	N/A
	During each of the tests, the ATSE:		
	- shall not transfer to position II when the supply characteristic is reduced or increased, if applicable, to a value within the deviation limits		N/A
	- shall transfer to position II when the supply characteristic is reduced or increased, if applicable, to a value outside of the deviation limits		N/A
	- shall either return to position I when the supply characteristic is restored, if set to "automatic return" mode, or stay in position II if set to "non-automatic return" mode		N/A
9.2.3.3.4	Operation on deviation of source II supply characteristics		
a)	For voltage supply deviation monitoring:		
	Transfer from position I to position II occurs within the source II voltage limits stated by the manufacturer:		
	- by increasing source II voltage starting from below the value stated by the manufacturer	see appended table 9.2.3.3.4	N/A
	- if overvoltage monitoring provided, by decreasing source II voltage starting from above the value stated by the manufacturer	see appended table 9.2.3.3.4	N/A
b)	For voltage and frequency deviation monitoring:		
1)	Transfer from position I to position II occurs within the frequency limits stated by the manufacturer.	see appended table 9.2.3.3.4	N/A
2)	Transfer from position I to position II occurs within the voltage limits stated by the manufacturer.	see appended table 9.2.3.3.4	N/A
3)	Transfer from position I to position II occurs within the frequency limits stated by the manufacturer.	see appended table 9.2.3.3.4	N/A
4)	Transfer from position I to position II occurs within the voltage limits stated by the manufacturer.	see appended table 9.2.3.3.4	N/A
9.2.3.3.5	Operation with in-phase transfer control function		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	If the ATSE is provided with deviation limits for in-phase voltage, frequency and phase angle, the test shall be made once with the limit set to the minimum value, and once with the limit set to the maximum value for adjustable units.		N/A
	When deviation limits are fixed, same tests shall be done within the specified limits.		N/A
	Transfer from one position to another occurs within the limits stated by the manufacturer.	see appended table 9.2.3.3.5	N/A
9.2.3.4	Tripping limits and characteristics		
	The tripping limits and characteristics of CB type TSE shall be verified according to 8.3.3.2 of IEC 60947-2:2016, IEC 60947-2:2016/AMD1:2019.	See Attachment XX	N/A
9.2.3.5	Temperature-rise		
	ambient temperature 10-40 °C	24,3°C	
	test enclosure W x H x D (mm x mm x mm)		
	material of enclosure		
	control circuit supply voltage (V)	110%Us	
	Main circuits, test conditions:		
	- rated operational current I _e (A)	100A	
	- conventional thermal current I _{th} (A)	100A	
	- conventional enclosed thermal current I _{the} (A)		
	- cable / busbar cross-section (mm ²) / length (mm) ..	35mm ²	
	Tested position:	position I	
	Fuse-link details (fuse-combination units only):		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference		
	- rated current (A)		
	- power loss (W)		
	- rated breaking capacity (kA)		
	Measured temperature-rise	see appended table 9.2.3.5	P
	Auxiliary circuits, test conditions:		
	- rated operation current (A)		
	- cable cross-section (mm ²)		
	Measured temperature-rise	see appended table 9.2.3.5	N/A
9.2.3.6	Dielectric properties		
	Verification of impulse withstand voltage		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Rated impulse withstand voltage (kV).....:	8kV(main circuit); 2,5kV(control and auxiliary circuit)	
	- test Uimp main circuits (kV).....:	see appended table 9.2.3.6 a)	P
	- test Uimp auxiliary circuits (kV).....:	see appended table 9.2.3.6 a)	P
	- test Uimp control circuits (kV).....:	see appended table 9.2.3.6 a)	P
	- test Uimp on open main contacts (equipment suitable for isolation) (kV).....:	see appended table 9.2.3.6 a)	P
	Power-frequency or DC withstand verification		
	- rated insulation voltage Ui (V)	800V(main circuit); 250V(control and auxiliary circuit)	P
	- main circuits, test voltage for 1 min. (V)	see appended table 9.2.3.6 b)	P
	- auxiliary circuits, test voltage for 1 min (V)	see appended table 9.2.3.6 b)	P
	- control circuits, test voltage for 1 min (V)	see appended table 9.2.3.6 b)	P
	Devices, which have been disconnected for the power-frequency withstand voltage test.....:		P
	Equipment suitable for isolation, leakage current not exceed 0,5 mA		
	Test voltage 1,1 Ue (V).....:	440V	P
	Measured leakage current (mA)	<0,01mA	P

9.2.4	TEST SEQUENCE II: OPERATIONAL PERFORMANCE CAPABILITY II-1, CDQ6i-100N/4PC		
9.2.4.1	Making and breaking capacities		
	- utilization category.....:	AC-33B	
	- rated operational voltage Ue (V).....:	400V	
	- rated operational current Ie (A).....:	100A	
	Fuse-link details (fuse-combination units only):		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference.....:		
	- rated current (A)		
	- power loss (W)		
	- rated breaking capacity (kA).....:		
	Test conditions, make/break operations:		
	- test voltage, U = 1,05 x Ue (V)	429V	

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- test current, $I = \dots\dots\dots 10 \times I_e$ (A):	1050	
	- power factor / time constant:	0,48	
	- transient recovery voltage (V).....:	429	P
	- current duration (ms).....:	3,29s	P
	- time interval between operations (s).....:	1min	P
	Number of make/break operations.....:	5	P
	Number of make/break operations for RTSE and ATSE using the manual operating means.....:	1	P
	Characteristic of transient recovery voltage		
	- oscillatory frequency (kHz).....:	66,0	
	- measured oscillatory frequency (kHz).....:	66,6	P
	- factor γ:	1,11	P
	Behaviour of the equipment during the test:		
	No failure during the test		P
	No melting of the fuse in the detection circuit		P
	Behaviour of the equipment after the test:		
	The operating mechanism shall be mechanically and/or electrically interlocked to prevent simultaneous connection to both source I and source II supplies under all conditions at the limits given in subclause 8.2.1.2 of IEC 60947-1:2020.		P
	The TSE shall be operated in each position (I, II and O if applicable) and each position of the switching device contacts shall be verified by electrical continuity test.		P
	For Class CC TSE, the drop-out test requirements of 9.3.3.2.1 of IEC 60947-1:2020 shall be verified.		N/A
	Compliance to opening and closing of main contacts is checked by inspection and by manual test.		P
9.2.4.2	Operational performance capability		
	- utilization category.....:	AC-33B	
	- rated operational voltage U_e (V).....:	400V	
	- rated operational current I_e (A).....:	100A	
9.2.4.2.2	Electrical operational performance		
	- test voltage, $U = 1,05 \times U_e$ (V).....:	429V	
	- test current, $I = 1 \times I_e$ (A).....:	105A	
	- power factor/time constant.....:	0,78	
	Number of operating cycles with current.....:	1500(300 cycles manual, 1200 cycles automatic)	P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Duration of operating cycles.....: 1 min		P
	Behaviour of the equipment during the test:		
	No failure during the test		P
	No melting of the fuse in the detection circuit		P
	Behaviour of the equipment after the test:		
	The operating mechanism shall be mechanically and/or electrically interlocked to prevent simultaneous connection to both source I and source II supplies under all conditions at the limits given in subclause 8.2.1.2 of IEC 60947-1:2020.		P
	The TSE shall be operated in each position (I, II and O if applicable) and each position of the switching device contacts shall be verified by electrical continuity test.		P
	For Class CC TSE, the drop-out test requirements of 9.3.3.2.1 of IEC 60947-1:2020 shall be verified.		N/A
	Compliance to opening and closing of main contacts is checked by inspection and by manual test.		P
9.2.4.2.3	Mechanical operational performance		
	Number of operating cycles with current.....: 4500		P
	Duration of operating cycles.....: 1 min		P
	Behaviour of the equipment after the test: TSE shall pass tests of 9.2.3.2.1 and 9.2.3.2.2		
9.2.3.2.1	Operation, general		P
	The operating mechanism shall be mechanically and/or electrically interlocked to prevent simultaneous connection to both source I and source II supplies under all conditions at the limits given in subclause 8.2.1.2 of IEC 60947-1:2020.		P
	The TSE shall be operated in each position (I, II and O if applicable) and each position of the switching device contacts shall be verified by electrical continuity test.		P
	For Class CC TSE, the drop-out test requirements of 9.3.3.2.1 of IEC 60947-1:2020 shall be verified.		N/A
	Compliance to opening and closing of main contacts is checked by inspection and by manual test.		P
9.2.3.2.2	Interlocking function verification		
9.2.3.2.2.2	Manual operation		
	The test performed without any electrical power available.		P
	For TSE equipped with a single manual actuator:		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	When the actuator is moved from position I to position II, it shall be verified that the terminals of source I are disconnected from the load terminals before the source II terminals are connected to the load terminals. The test shall be repeated from position II to position I.		P
	For TSE equipped with distinct manual actuators for each source switching device. Following sequence shall be verified:		
a)	With source I switching device in closed position, it shall be verified that source II switching device cannot be manually switched to closed position;		N/A
b)	With source II switching device in closed position, it shall be verified that source I switching device cannot be manually switched to closed position;		N/A
c)	With source I and source II switching devices both in open position, it shall be verified that simultaneous closing operations do not result in the closure of both switching devices at any time.		N/A
9.2.3.2.2.3	Electrically controlled operation		
	Following tests made with control circuit supply voltage 85 % and 110 % of rated value.		P
	If the interlock of the TSE requires electrical power, the test shall be conducted with this power supply connected and disconnected.		P
	For TSE equipped of a single remote actuator:		
	When a remote order to transfer from position I to position II is applied, it shall be verified that the load terminals are disconnected from source I terminals before being connected to source II terminals. The test shall be repeated from position II to position I.		P
	For TSE equipped of distinct remote actuators for each switching device. Following sequence shall be verified:		
a)	With source I and source II switching devices in the open position, it shall be verified that giving the order to switch both switching devices to close simultaneously for 5 s does not result in the closure of both devices. This test is applicable only to RTSE and ATSE allowing to send simultaneous transfer orders to position I and position II.		N/A
b)	With source I switching device in closed position, it shall be verified that sending a remote closing order on source II switching device for 5 s does not result in the closure of both switching devices at any time.		N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
c)	With source II switching device in closed position, it shall be verified that sending a remote closing order on source I switching device for 5 s does not result in the closure of both switching devices at any time.		N/A
	If the minimum contact transfer time is lower than 75 % of the initial value and is lower than 200 ms for alternating current or 1 000 ms for direct current, the TSE shall be subjected to a making and breaking capacity test according to 9.2.4.1, except that only three operations are required.		N/A
	Alternatively, at the discretion of the manufacturer, the making and breaking test of 9.2.4.1 may be made after the electrical and mechanical operational performance tests.		N/A
9.2.4.1	Making and breaking capacities		
	- utilization category.....:		
	- rated operational voltage U_e (V).....:		
	- rated operational current I_e (A).....:		
	Fuse-link details (fuse-combination units only):		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference.....:		
	- rated current (A)		
	- power loss (W)		
	- rated breaking capacity (kA).....:		
	Test conditions, make/break operations:		
	- test voltage, $U = 1,05 \times U_e$ (V)		
	- test current, $I = \dots \times I_e$ (A):		
	- power factor/time constant		
	- transient recovery voltage (V).....:		N/A
	- current duration (ms)		N/A
	- time interval between operations (s).....:		N/A
	Number of make/break operations		N/A
	Number of make/break operations for RTSE and ATSE using the manual operating means.....:		N/A
	Characteristic of transient recovery voltage		
	- oscillatory frequency (kHz).....:		
	- measured oscillatory frequency (kHz).....:		N/A
	- factor γ		N/A
	Behaviour of the equipment during the test:		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	No failure during the test		N/A
	No melting of the fuse in the detection circuit		N/A
	Behaviour of the equipment after the test:		
	The operating mechanism shall be mechanically and/or electrically interlocked to prevent simultaneous connection to both source I and source II supplies under all conditions at the limits given in subclause 8.2.1.2 of IEC 60947-1:2020.		N/A
	The TSE shall be operated in each position (I, II and O if applicable) and each position of the switching device contacts shall be verified by electrical continuity test.		N/A
	For Class CC TSE, the drop-out test requirements of 9.3.3.2.1 of IEC 60947-1:2020 shall be verified.		N/A
	Compliance to opening and closing of main contacts is checked by inspection and by manual test.		N/A
9.2.4.3	Verification of dielectric withstand		
	Dielectric verification		
	test voltage (2 x Ue) for 1min (V) (min.1000V AC / 1415V DC)	1000V	P
	No breakdown or flashover		P
	Leakage current		
	test voltage (1,1 x Ue) (V)	440V	P
	Leakage current ≤ 2 mA / pole	<0,1mA	P
9.2.4.4	Verification of temperature-rise		
	Fuse-link details (fuse-combination units only):		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference.....		
	- rated current (A)		
	- power loss (W)		
	- rated breaking capacity (kA).....		
	- conductor cross-section (mm ²)	35mm ²	
	- test current I _e (A).....	100A	
	Measured temperature-rise.....	see appended table 9.2.4.4	P
9.2.4.5	Verification of overload releases		
	Applies Class CB TSE only		N/A
	Test current: 1.45 times the value of their current setting at the reference temperature: (A).....		N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Conventional tripping time (min / s):..... : <1h when $I_n < 63A$, <2h when $I_n > 63 A$		N/A
9.2.4.6	Verification of the effectiveness of indication of the main contact position of equipment suitable for isolation		
	Applies for Class PC TSE and Class CB TSE suitable for isolation	Class PC	P
9.2.6 part 1	- actuator type (fig.)..... :		
9.2.6.2.1	Dependent and independent manual operation		
	- actuating force for opening (N)..... :	40,3N	
	- test force with blocked main contacts (N)..... :	150N	
	- used method to keep the contact closed..... :	Welding	
	During and after the test, open position not indicated :		P
	Equipment with locking mean, no locking in the open position while test force is applied :		N/A
9.2.6.2.2	Dependent power operation		
	- main contacts fixed together in the closed position :		N/A
	- used method to keep the contact closed..... :		
	- 110% of the rated supply voltage applied to the equipment (3 times)..... :		N/A
	During and after the test, open position not indicated :		N/A
	Equipment show no damage impairing its normal operation..... :		N/A
	Equipment with locking mean, no locking in the open position while test force is applied :		N/A
9.2.6.2.3	Independent power operation		
	- main contacts fixed together in the closed position :		P
	- used method to keep the contact closed..... :	Welding	
	- stored energy of the power operator released (3 times)..... :		P
	During and after the test, open position not indicated :		P
	Equipment show no damage impairing its normal operation..... :		P
	Equipment with locking mean, no locking in the open position while test force is applied :		N/A

IEC 60947-6-1			
Clause	Requirement + Test		Verdict
9.2.4	TEST SEQUENCE II: OPERATIONAL PERFORMANCE CAPABILITY II-2, CDQ6i-100H/4PCD		
9.2.4.1	Making and breaking capacities		
	- utilization category	AC-33B	
	- rated operational voltage U_e (V)	400V	
	- rated operational current I_e (A)	100A	
	Fuse-link details (fuse-combination units only):		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference		
	- rated current (A)		
	- power loss (W)		
	- rated breaking capacity (kA)		
	Test conditions, make/break operations:		
	- test voltage, $U = 1,05 \times U_e$ (V)	429V	
	- test current, $I = \dots\dots\dots 10 \times I_e$ (A):	1050	
	- power factor / time constant	0,43	
	- transient recovery voltage (V)	429	P
	- current duration (ms)	3,51s	P
	- time interval between operations (s)	1min	P
	Number of make/break operations	5	P
	Number of make/break operations for RTSE and ATSE using the manual operating means	1	P
	Characteristic of transient recovery voltage		
	- oscillatory frequency (kHz)	66,0	
	- measured oscillatory frequency (kHz)	66,6	P
	- factor γ	1,11	P
	Behaviour of the equipment during the test:		
	No failure during the test		P
	No melting of the fuse in the detection circuit		P
	Behaviour of the equipment after the test:		
	The operating mechanism shall be mechanically and/or electrically interlocked to prevent simultaneous connection to both source I and source II supplies under all conditions at the limits given in subclause 8.2.1.2 of IEC 60947-1:2020.		P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	The TSE shall be operated in each position (I, II and O if applicable) and each position of the switching device contacts shall be verified by electrical continuity test.		P
	For Class CC TSE, the drop-out test requirements of 9.3.3.2.1 of IEC 60947-1:2020 shall be verified.		N/A
	Compliance to opening and closing of main contacts is checked by inspection and by manual test.		P
9.2.4.2	Operational performance capability		
	- utilization category.....: AC-33B		
	- rated operational voltage U _e (V).....: 400V		
	- rated operational current I _e (A).....: 100A		
9.2.4.2.2	Electrical operational performance		
	- test voltage, U = 1,05 x U _e (V): 429V		
	- test current, I = 1 x I _e (A): 105A		
	- power factor/time constant.....: 0,78		
	Number of operating cycles with current.....: 1500(300 cycles manual, 1200 cycles automatic)		P
	Duration of operating cycles.....: 1 min		P
	Behaviour of the equipment during the test:		
	No failure during the test		P
	No melting of the fuse in the detection circuit		P
	Behaviour of the equipment after the test:		
	The operating mechanism shall be mechanically and/or electrically interlocked to prevent simultaneous connection to both source I and source II supplies under all conditions at the limits given in subclause 8.2.1.2 of IEC 60947-1:2020.		P
	The TSE shall be operated in each position (I, II and O if applicable) and each position of the switching device contacts shall be verified by electrical continuity test.		P
	For Class CC TSE, the drop-out test requirements of 9.3.3.2.1 of IEC 60947-1:2020 shall be verified.		N/A
	Compliance to opening and closing of main contacts is checked by inspection and by manual test.		P
9.2.4.2.3	Mechanical operational performance		
	Number of operating cycles with current.....: 4500		P
	Duration of operating cycles.....: 1 min		P
	Behaviour of the equipment after the test: TSE shall pass tests of 9.2.3.2.1 and 9.2.3.2.2		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
9.2.3.2.1	Operation, general		P
	The operating mechanism shall be mechanically and/or electrically interlocked to prevent simultaneous connection to both source I and source II supplies under all conditions at the limits given in subclause 8.2.1.2 of IEC 60947-1:2020.		P
	The TSE shall be operated in each position (I, II and O if applicable) and each position of the switching device contacts shall be verified by electrical continuity test.		P
	For Class CC TSE, the drop-out test requirements of 9.3.3.2.1 of IEC 60947-1:2020 shall be verified.		N/A
	Compliance to opening and closing of main contacts is checked by inspection and by manual test.		P
9.2.3.2.2	Interlocking function verification		
9.2.3.2.2.2	Manual operation		
	The test performed without any electrical power available.		P
	For TSE equipped with a single manual actuator:		
	When the actuator is moved from position I to position II, it shall be verified that the terminals of source I are disconnected from the load terminals before the source II terminals are connected to the load terminals. The test shall be repeated from position II to position I.		P
	For TSE equipped with distinct manual actuators for each source switching device. Following sequence shall be verified:		
a)	With source I switching device in closed position, it shall be verified that source II switching device cannot be manually switched to closed position;		N/A
b)	With source II switching device in closed position, it shall be verified that source I switching device cannot be manually switched to closed position;		N/A
c)	With source I and source II switching devices both in open position, it shall be verified that simultaneous closing operations do not result in the closure of both switching devices at any time.		N/A
9.2.3.2.2.3	Electrically controlled operation		
	Following tests made with control circuit supply voltage 85 % and 110 % of rated value.		P
	If the interlock of the TSE requires electrical power, the test shall be conducted with this power supply connected and disconnected.		P
	For TSE equipped of a single remote actuator:		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	When a remote order to transfer from position I to position II is applied, it shall be verified that the load terminals are disconnected from source I terminals before being connected to source II terminals. The test shall be repeated from position II to position I.		P
	For TSE equipped of distinct remote actuators for each switching device. Following sequence shall be verified:		
a)	With source I and source II switching devices in the open position, it shall be verified that giving the order to switch both switching devices to close simultaneously for 5 s does not result in the closure of both devices. This test is applicable only to RTSE and ATSE allowing to send simultaneous transfer orders to position I and position II.		N/A
b)	With source I switching device in closed position, it shall be verified that sending a remote closing order on source II switching device for 5 s does not result in the closure of both switching devices at any time.		N/A
c)	With source II switching device in closed position, it shall be verified that sending a remote closing order on source I switching device for 5 s does not result in the closure of both switching devices at any time.		N/A
	If the minimum contact transfer time is lower than 75 % of the initial value and is lower than 200 ms for alternating current or 1 000 ms for direct current, the TSE shall be subjected to a making and breaking capacity test according to 9.2.4.1, except that only three operations are required.		N/A
	Alternatively, at the discretion of the manufacturer, the making and breaking test of 9.2.4.1 may be made after the electrical and mechanical operational performance tests.		N/A
9.2.4.1	Making and breaking capacities		
	- utilization category		
	- rated operational voltage Ue (V).....		
	- rated operational current Ie (A).....		
	Fuse-link details (fuse-combination units only):		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference.....		
	- rated current (A)		
	- power loss (W)		
	- rated breaking capacity (kA).....		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Test conditions, make/break operations:		
	- test voltage, $U = 1,05 \times U_e$ (V)		
	- test current, $I = \dots \times I_e$ (A):		
	- power factor/time constant		
	- transient recovery voltage (V).....		N/A
	- current duration (ms)		N/A
	- time interval between operations (s)		N/A
	Number of make/break operations		N/A
	Number of make/break operations for RTSE and ATSE using the manual operating means.....		N/A
	Characteristic of transient recovery voltage		
	- oscillatory frequency (kHz).....		
	- measured oscillatory frequency (kHz).....		N/A
	- factor γ		N/A
	Behaviour of the equipment during the test:		
	No failure during the test		N/A
	No melting of the fuse in the detection circuit		N/A
	Behaviour of the equipment after the test:		
	The operating mechanism shall be mechanically and/or electrically interlocked to prevent simultaneous connection to both source I and source II supplies under all conditions at the limits given in subclause 8.2.1.2 of IEC 60947-1:2020.		N/A
	The TSE shall be operated in each position (I, II and O if applicable) and each position of the switching device contacts shall be verified by electrical continuity test.		N/A
	For Class CC TSE, the drop-out test requirements of 9.3.3.2.1 of IEC 60947-1:2020 shall be verified.		N/A
	Compliance to opening and closing of main contacts is checked by inspection and by manual test.		N/A
9.2.4.3	Verification of dielectric withstand		
	Dielectric verification		
	test voltage ($2 \times U_e$) for 1min (V) (min.1000V AC / 1415V DC)	1000V	P
	No breakdown or flashover		P
	Leakage current		
	test voltage ($1,1 \times U_e$) (V)	440V	P
	Leakage current ≤ 2 mA / pole	<0,1mA	P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
9.2.4.4	Verification of temperature-rise		
	Fuse-link details (fuse-combination units only):		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference.....		
	- rated current (A)		
	- power loss (W)		
	- rated breaking capacity (kA).....		
	- conductor cross-section (mm ²)	35mm ²	
	- test current I _e (A).....	100A	
	Measured temperature-rise	see appended table 9.2.4.4	P
9.2.4.5	Verification of overload releases		
	Applies Class CB TSE only		N/A
	Test current: 1.45 times the value of their current setting at the reference temperature: (A)		N/A
	Conventional tripping time (min / s):..... <1h when I _n < 63A, <2h when I _n > 63 A		N/A
9.2.4.6	Verification of the effectiveness of indication of the main contact position of equipment suitable for isolation		
	Applies for Class PC TSE and Class CB TSE suitable for isolation	Class PC	P
9.2.6 part 1	- actuator type (fig.).....		
9.2.6.2.1	Dependent and independent manual operation		
	- actuating force for opening (N)	41,3N	
	- test force with blocked main contacts (N).....	150N	
	- used method to keep the contact closed.....	Welding	
	During and after the test, open position not indicated		P
	Equipment with locking mean, no locking in the open position while test force is applied		N/A
9.2.6.2.2	Dependent power operation		
	- main contacts fixed together in the closed position :		N/A
	- used method to keep the contact closed.....		
	- 110% of the rated supply voltage applied to the equipment (3 times).....		N/A
	During and after the test, open position not indicated		N/A
	Equipment show no damage impairing its normal operation.....		N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Equipment with locking mean, no locking in the open position while test force is applied		N/A
9.2.6.2.3	Independent power operation		
	- main contacts fixed together in the closed position :		P
	- used method to keep the contact closed.....	Welding	
	- stored energy of the power operator released (3 times).....		P
	During and after the test, open position not indicated		P
	Equipment show no damage impairing its normal operation.....		P
	Equipment with locking mean, no locking in the open position while test force is applied		N/A

9.2.4	TEST SEQUENCE II: OPERATIONAL PERFORMANCE CAPABILITY II-3, CDQ6i-100H/2P		
9.2.4.1	Making and breaking capacities		
	- utilization category	AC-33B	
	- rated operational voltage U_e (V).....	230V	
	- rated operational current I_e (A).....	100A	
	Fuse-link details (fuse-combination units only):		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference.....		
	- rated current (A)		
	- power loss (W)		
	- rated breaking capacity (kA).....		
	Test conditions, make/break operations:		
	- test voltage, $U = 1,05 \times U_e$ (V)	248V	
	- test current, $I = \dots\dots\dots 10 \times I_e$ (A):	1020	
	- power factor / time constant	0,43	
	- transient recovery voltage (V).....	248	P
	- current duration (ms)	3,29s	P
	- time interval between operations (s).....	1min	P
	Number of make/break operations	5	P
	Number of make/break operations for RTSE and ATSE using the manual operating means.....	1	P
	Characteristic of transient recovery voltage		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- oscillatory frequency (kHz).....:	102,7	
	- measured oscillatory frequency (kHz).....:	103	P
	- factor γ:	1,08	P
	Behaviour of the equipment during the test:		
	No failure during the test		P
	No melting of the fuse in the detection circuit		P
	Behaviour of the equipment after the test:		
	The operating mechanism shall be mechanically and/or electrically interlocked to prevent simultaneous connection to both source I and source II supplies under all conditions at the limits given in subclause 8.2.1.2 of IEC 60947-1:2020.		P
	The TSE shall be operated in each position (I, II and O if applicable) and each position of the switching device contacts shall be verified by electrical continuity test.		P
	For Class CC TSE, the drop-out test requirements of 9.3.3.2.1 of IEC 60947-1:2020 shall be verified.		N/A
	Compliance to opening and closing of main contacts is checked by inspection and by manual test.		P
9.2.4.2	Operational performance capability		
	- utilization category.....:	AC-33B	
	- rated operational voltage U_e (V).....:	230V	
	- rated operational current I_e (A).....:	100A	
9.2.4.2.2	Electrical operational performance		
	- test voltage, $U = 1,05 \times U_e$ (V).....:	248V	
	- test current, $I = 1 \times I_e$ (A).....:	103A	
	- power factor/time constant.....:	0,78	
	Number of operating cycles with current.....:	1500(300 cycles manual, 1200 cycles automatic)	P
	Duration of operating cycles.....:	1 min	P
	Behaviour of the equipment during the test:		
	No failure during the test		P
	No melting of the fuse in the detection circuit		P
	Behaviour of the equipment after the test:		
	The operating mechanism shall be mechanically and/or electrically interlocked to prevent simultaneous connection to both source I and source II supplies under all conditions at the limits given in subclause 8.2.1.2 of IEC 60947-1:2020.		P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	The TSE shall be operated in each position (I, II and O if applicable) and each position of the switching device contacts shall be verified by electrical continuity test.		P
	For Class CC TSE, the drop-out test requirements of 9.3.3.2.1 of IEC 60947-1:2020 shall be verified.		N/A
	Compliance to opening and closing of main contacts is checked by inspection and by manual test.		P
9.2.4.2.3	Mechanical operational performance		
	Number of operating cycles with current: 4500		P
	Duration of operating cycles: 1 min		P
	Behaviour of the equipment after the test: TSE shall pass tests of 9.2.3.2.1 and 9.2.3.2.2		
9.2.3.2.1	Operation, general		P
	The operating mechanism shall be mechanically and/or electrically interlocked to prevent simultaneous connection to both source I and source II supplies under all conditions at the limits given in subclause 8.2.1.2 of IEC 60947-1:2020.		P
	The TSE shall be operated in each position (I, II and O if applicable) and each position of the switching device contacts shall be verified by electrical continuity test.		P
	For Class CC TSE, the drop-out test requirements of 9.3.3.2.1 of IEC 60947-1:2020 shall be verified.		N/A
	Compliance to opening and closing of main contacts is checked by inspection and by manual test.		P
9.2.3.2.2	Interlocking function verification		
9.2.3.2.2.2	Manual operation		
	The test performed without any electrical power available.		P
	For TSE equipped with a single manual actuator:		
	When the actuator is moved from position I to position II, it shall be verified that the terminals of source I are disconnected from the load terminals before the source II terminals are connected to the load terminals. The test shall be repeated from position II to position I.		P
	For TSE equipped with distinct manual actuators for each source switching device. Following sequence shall be verified:		
a)	With source I switching device in closed position, it shall be verified that source II switching device cannot be manually switched to closed position;		N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
b)	With source II switching device in closed position, it shall be verified that source I switching device cannot be manually switched to closed position;		N/A
c)	With source I and source II switching devices both in open position, it shall be verified that simultaneous closing operations do not result in the closure of both switching devices at any time.		N/A
9.2.3.2.2.3	Electrically controlled operation		
	Following tests made with control circuit supply voltage 85 % and 110 % of rated value.		P
	If the interlock of the TSE requires electrical power, the test shall be conducted with this power supply connected and disconnected.		P
	For TSE equipped of a single remote actuator:		
	When a remote order to transfer from position I to position II is applied, it shall be verified that the load terminals are disconnected from source I terminals before being connected to source II terminals. The test shall be repeated from position II to position I.		P
	For TSE equipped of distinct remote actuators for each switching device. Following sequence shall be verified:		
a)	With source I and source II switching devices in the open position, it shall be verified that giving the order to switch both switching devices to close simultaneously for 5 s does not result in the closure of both devices. This test is applicable only to RTSE and ATSE allowing to send simultaneous transfer orders to position I and position II.		N/A
b)	With source I switching device in closed position, it shall be verified that sending a remote closing order on source II switching device for 5 s does not result in the closure of both switching devices at any time.		N/A
c)	With source II switching device in closed position, it shall be verified that sending a remote closing order on source I switching device for 5 s does not result in the closure of both switching devices at any time.		N/A
	If the minimum contact transfer time is lower than 75 % of the initial value and is lower than 200 ms for alternating current or 1 000 ms for direct current, the TSE shall be subjected to a making and breaking capacity test according to 9.2.4.1, except that only three operations are required.		N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Alternatively, at the discretion of the manufacturer, the making and breaking test of 9.2.4.1 may be made after the electrical and mechanical operational performance tests.		N/A
9.2.4.1	Making and breaking capacities		
	- utilization category		
	- rated operational voltage U_e (V)		
	- rated operational current I_e (A)		
	Fuse-link details (fuse-combination units only):		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference		
	- rated current (A)		
	- power loss (W)		
	- rated breaking capacity (kA)		
	Test conditions, make/break operations:		
	- test voltage, $U = 1,05 \times U_e$ (V)		
	- test current, $I = \dots \times I_e$ (A):		
	- power factor/time constant		
	- transient recovery voltage (V)		N/A
	- current duration (ms)		N/A
	- time interval between operations (s)		N/A
	Number of make/break operations		N/A
	Number of make/break operations for RTSE and ATSE using the manual operating means		N/A
	Characteristic of transient recovery voltage		
	- oscillatory frequency (kHz)		
	- measured oscillatory frequency (kHz)		N/A
	- factor γ		N/A
	Behaviour of the equipment during the test:		
	No failure during the test		N/A
	No melting of the fuse in the detection circuit		N/A
	Behaviour of the equipment after the test:		
	The operating mechanism shall be mechanically and/or electrically interlocked to prevent simultaneous connection to both source I and source II supplies under all conditions at the limits given in subclause 8.2.1.2 of IEC 60947-1:2020.		N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	The TSE shall be operated in each position (I, II and O if applicable) and each position of the switching device contacts shall be verified by electrical continuity test.		N/A
	For Class CC TSE, the drop-out test requirements of 9.3.3.2.1 of IEC 60947-1:2020 shall be verified.		N/A
	Compliance to opening and closing of main contacts is checked by inspection and by manual test.		N/A
9.2.4.3	Verification of dielectric withstand		
	Dielectric verification		
	test voltage (2 x Ue) for 1min (V) (min.1000V AC / 1415V DC)	1000V	P
	No breakdown or flashover		P
	Leakage current		
	test voltage (1,1 x Ue) (V)	440V	P
	Leakage current ≤ 2 mA / pole	0,415mA	P
9.2.4.4	Verification of temperature-rise		
	Fuse-link details (fuse-combination units only):		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference.....		
	- rated current (A)		
	- power loss (W)		
	- rated breaking capacity (kA).....		
	- conductor cross-section (mm ²)	35mm ²	
	- test current Ie (A).....	100A	
	Measured temperature-rise.....	see appended table 9.2.4.4	P
9.2.4.5	Verification of overload releases		
	Applies Class CB TSE only		N/A
	Test current: 1.45 times the value of their current setting at the reference temperature: (A)		N/A
	Conventional tripping time (min / s):..... <1h when I _n < 63A, <2h when I _n > 63 A		N/A
9.2.4.6	Verification of the effectiveness of indication of the main contact position of equipment suitable for isolation		
	Applies for Class PC TSE and Class CB TSE suitable for isolation	Class PC	P
9.2.6 part 1	- actuator type (fig.).....		
9.2.6.2.1	Dependent and independent manual operation		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- actuating force for opening (N)	41,8N	
	- test force with blocked main contacts (N).....	150N	
	- used method to keep the contact closed.....	Welding	
	During and after the test, open position not indicated		P
	Equipment with locking mean, no locking in the open position while test force is applied		N/A
9.2.6.2.2	Dependent power operation		
	- main contacts fixed together in the closed position :		N/A
	- used method to keep the contact closed.....		
	- 110% of the rated supply voltage applied to the equipment (3 times).....		N/A
	During and after the test, open position not indicated		N/A
	Equipment show no damage impairing its normal operation.....		N/A
	Equipment with locking mean, no locking in the open position while test force is applied		N/A
9.2.6.2.3	Independent power operation		
	- main contacts fixed together in the closed position :		P
	- used method to keep the contact closed.....	Welding	
	- stored energy of the power operator released (3 times).....		P
	During and after the test, open position not indicated		P
	Equipment show no damage impairing its normal operation.....		P
	Equipment with locking mean, no locking in the open position while test force is applied		N/A

9.2.5	TEST SEQUENCE III – SHORT-CIRCUIT PERFORMANCE CAPABILITY III-1, CDQ6i-100N/4PC		
9.2.5.2	Short-time withstand current		
	Rated short-time withstand current I _{cw} (kA).....	5kA/30ms	
	- test voltage (V)	429V	
	- r.m.s test current (kA)	5,1kA	
	- peak test current (kA)	7,81kA	
	- power factor/time constant	0,68	

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- current duration (s)	30ms	
	Behaviour of the equipment during the test		P
	Behaviour of the equipment after the test:		
	TSE contacts shall close and open by their normal means. No contact welding.		P
	No melting of the fuse in the detection circuit		P
	No breakage of the TSE to the extent that the integrity of the mounting of live parts is impaired		P
	Enclosed TSE: The door shall be prevented by its latching means, without additional locking means, from being blown open, but deformation of the door alone is not considered to constitute a failure, provided the requirements of degree of protection IP2X are met.		N/A
9.2.5.3	Short-circuit making capacity		
	Rated short-circuit making capacity I _{cm} (kA)	7,56kA	
	- test voltage (V)	429V	
	- r.m.s test current (kA)	7,81kA	
	- maximum peak test current (kA)	7,81kA	
	- power factor/time constant	0,68	
	- current duration (s)	30,3ms	
	Behaviour of the equipment during the test		P
	Behaviour of the equipment after the test:		
	TSE contacts shall close and open by their normal means. No contact welding.		P
	No melting of the fuse in the detection circuit		P
	No breakage of the TSE to the extent that the integrity of the mounting of live parts is impaired		P
	Enclosed TSE: The door shall be prevented by its latching means, without additional locking means, from being blown open, but deformation of the door alone is not considered to constitute a failure, provided the requirements of degree of protection IP2X are met.		N/A
9.2.5.4	Short-circuit breaking capacity		
9.2.5.4.3	Verification of overload releases		
	The operation of overload releases shall be verified at twice the value of their current setting on each pole separately.		
	The operating time shall not exceed the max. value stated by the manufacturer for twice the current setting at the reference temperature, on a pole singly.		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Time specified by the manufacturer:		N/A
	- Operation time:(s).....:	L1: L2: L3: N:	N/A
9.2.5.4.4	Test of rated short-circuit breaking capacity		
	Rated short-circuit breaking capacity I_{cn} (kA)		
	Test sequence of operation: O – t – CO		
	- test voltage (V).....:		
	- r.m.s test current (kA)		
	- power factor/time constant		
	- Factor "n"		
	- peak test current (kA max)		
	Test sequence "O"		
	- max. let-through current (kA peak)		
	- joule integral I^2dt (A ² s).....:		
	Pause, t: (min)		
	Test sequence "CO"		
	- max. let-through current (kA peak)		
	- joule integral I^2dt (A ² s).....:		
	Behaviour of the equipment during the test		N/A
	Behaviour of the equipment after the test:		
	TSE contacts shall close and open by their normal means. No contact welding.		N/A
	No melting of the fuse in the detection circuit		N/A
	No breakage of the TSE to the extent that the integrity of the mounting of live parts is impaired		N/A
	Enclosed TSE: The door shall be prevented by its latching means, without additional locking means, from being blown open, but deformation of the door alone is not considered to constitute a failure, provided the requirements of degree of protection IP2X are met.		N/A
9.2.5.4.5	Verification of overload releases		
	The operation of overload releases shall be verified at 2,5 times the value of their current setting on each pole separately.		
	The operating time shall not exceed the max. value stated by the manufacturer for twice the current setting at the reference temperature, on a pole singly.		
	Time specified by the manufacturer:		N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- Operation time:(s).....:	L1: L2: L3: N:	N/A
9.2.5.5	Verification of dielectric withstand		
	Dielectric verification		
	test voltage (2 x Ue) for 1min (V) (min.1000V AC / 1415V DC)	1000V	P
	No breakdown or flashover		P
	Leakage current		
	test voltage (1,1 x Ue) (V)	440V	P
	Leakage current ≤ 2 mA / pole	<0,1mA	P
9.2.5.6	Verification of temperature-rise		
	Fuse-link details (fuse-combination units only):		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference.....:		
	- rated current (A)		
	- power loss (W)		
	- rated breaking capacity (kA).....:		
	- conductor cross-section (mm ²)	35mm ²	
	- test current Ie (A).....:	100	
	Measured temperature-rise.....:	see appended table 9.2.5.6	P

9.2.5	TEST SEQUENCE III – SHORT-CIRCUIT PERFORMANCE CAPABILITY III-2, CDQ6i-100H/4PCD		
9.2.5.2	Short-time withstand current		
	Rated short-time withstand current I _{cw} (kA).....:	5kA/30ms	
	- test voltage (V)	429V	
	- r.m.s test current (kA)	5,1kA	
	- peak test current (kA)	7,81kA	
	- power factor/time constant	0,68	
	- current duration (s)	30ms	
	Behaviour of the equipment during the test		P
	Behaviour of the equipment after the test:		
	TSE contacts shall close and open by their normal means. No contact welding.		P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	No melting of the fuse in the detection circuit		P
	No breakage of the TSE to the extent that the integrity of the mounting of live parts is impaired		P
	Enclosed TSE: The door shall be prevented by its latching means, without additional locking means, from being blown open, but deformation of the door alone is not considered to constitute a failure, provided the requirements of degree of protection IP2X are met.		N/A
9.2.5.3	Short-circuit making capacity		
	Rated short-circuit making capacity I _{cm} (kA)	7,56kA	
	- test voltage (V)	429V	
	- r.m.s test current (kA)	7,81kA	
	- maximum peak test current (kA)	7,81kA	
	- power factor/time constant	0,68	
	- current duration (s)	30,3ms	
	Behaviour of the equipment during the test		P
	Behaviour of the equipment after the test:		
	TSE contacts shall close and open by their normal means. No contact welding.		P
	No melting of the fuse in the detection circuit		P
	No breakage of the TSE to the extent that the integrity of the mounting of live parts is impaired		P
	Enclosed TSE: The door shall be prevented by its latching means, without additional locking means, from being blown open, but deformation of the door alone is not considered to constitute a failure, provided the requirements of degree of protection IP2X are met.		N/A
9.2.5.4	Short-circuit breaking capacity		
9.2.5.4.3	Verification of overload releases		
	The operation of overload releases shall be verified at twice the value of their current setting on each pole separately.		
	The operating time shall not exceed the max. value stated by the manufacturer for twice the current setting at the reference temperature, on a pole singly.		
	Time specified by the manufacturer:		N/A
	- Operation time:(s).....	L1: L2: L3: N:	N/A
9.2.5.4.4	Test of rated short-circuit breaking capacity		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Rated short-circuit breaking capacity I_{cn} (kA)		
	Test sequence of operation: O – t – CO		
	- test voltage (V)		
	- r.m.s test current (kA)		
	- power factor/time constant		
	- Factor "n"		
	- peak test current (kA max)		
	Test sequence "O"		
	- max. let-through current (kA peak)		
	- joule integral I^2dt (A ² s).....		
	Pause, t: (min)		
	Test sequence "CO"		
	- max. let-through current (kA peak)		
	- joule integral I^2dt (A ² s).....		
	Behaviour of the equipment during the test		N/A
	Behaviour of the equipment after the test:		
	TSE contacts shall close and open by their normal means. No contact welding.		N/A
	No melting of the fuse in the detection circuit		N/A
	No breakage of the TSE to the extent that the integrity of the mounting of live parts is impaired		N/A
	Enclosed TSE: The door shall be prevented by its latching means, without additional locking means, from being blown open, but deformation of the door alone is not considered to constitute a failure, provided the requirements of degree of protection IP2X are met.		N/A
9.2.5.4.5	Verification of overload releases		
	The operation of overload releases shall be verified at 2,5 times the value of their current setting on each pole separately.		
	The operating time shall not exceed the max. value stated by the manufacturer for twice the current setting at the reference temperature, on a pole singly.		
	Time specified by the manufacturer:		N/A
	- Operation time:(s).....	L1: L2: L3: N:	N/A
9.2.5.5	Verification of dielectric withstand		
	Dielectric verification		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	test voltage (2 x Ue) for 1min (V) (min.1000V AC / 1415V DC)	1000V	P
	No breakdown or flashover		P
	Leakage current		
	test voltage (1,1 x Ue) (V)	440V	P
	Leakage current ≤ 2 mA / pole	<0,1mA	P
9.2.5.6	Verification of temperature-rise		
	Fuse-link details (fuse-combination units only):		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference.....		
	- rated current (A)		
	- power loss (W)		
	- rated breaking capacity (kA).....		
	- conductor cross-section (mm ²)	35mm ²	
	- test current Ie (A).....	100	
	Measured temperature-rise.....	see appended table 9.2.5.6	P

9.2.5	TEST SEQUENCE III – SHORT-CIRCUIT PERFORMANCE CAPABILITY III-3, CDQ6i-100H/2P		
9.2.5.2	Short-time withstand current		
	Rated short-time withstand current I _{cw} (kA).....	5kA/30ms	
	- test voltage (V)	230V	
	- r.m.s test current (kA)	5,1kA	
	- peak test current (kA)	7,81kA	
	- power factor/time constant	0,68	
	- current duration (s)	30ms	
	Behaviour of the equipment during the test		P
	Behaviour of the equipment after the test:		
	TSE contacts shall close and open by their normal means. No contact welding.		P
	No melting of the fuse in the detection circuit		P
	No breakage of the TSE to the extent that the integrity of the mounting of live parts is impaired		P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Enclosed TSE: The door shall be prevented by its latching means, without additional locking means, from being blown open, but deformation of the door alone is not considered to constitute a failure, provided the requirements of degree of protection IP2X are met.		N/A
9.2.5.3	Short-circuit making capacity		
	Rated short-circuit making capacity I _{cm} (kA)	7,56kA	
	- test voltage (V)	248V	
	- r.m.s test current (kA)	7,81kA	
	- maximum peak test current (kA)	7,81kA	
	- power factor/time constant	0,68	
	- current duration (s)	30,4ms	
	Behaviour of the equipment during the test		P
	Behaviour of the equipment after the test:		
	TSE contacts shall close and open by their normal means. No contact welding.		P
	No melting of the fuse in the detection circuit		P
	No breakage of the TSE to the extent that the integrity of the mounting of live parts is impaired		P
	Enclosed TSE: The door shall be prevented by its latching means, without additional locking means, from being blown open, but deformation of the door alone is not considered to constitute a failure, provided the requirements of degree of protection IP2X are met.		N/A
9.2.5.4	Short-circuit breaking capacity		
9.2.5.4.3	Verification of overload releases		
	The operation of overload releases shall be verified at twice the value of their current setting on each pole separately.		
	The operating time shall not exceed the max. value stated by the manufacturer for twice the current setting at the reference temperature, on a pole singly.		
	Time specified by the manufacturer:		N/A
	- Operation time:(s).....	L1: L2: L3: N:	N/A
9.2.5.4.4	Test of rated short-circuit breaking capacity		
	Rated short-circuit breaking capacity I _{cn} (kA)		
	Test sequence of operation: O – t – CO		
	- test voltage (V)		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- r.m.s test current (kA)		
	- power factor/time constant		
	- Factor "n"		
	- peak test current (kA max)		
	Test sequence "O"		
	- max. let-through current (kA peak)		
	- joule integral I^2dt (A ² s).....		
	Pause, t: (min)		
	Test sequence "CO"		
	- max. let-through current (kA peak)		
	- joule integral I^2dt (A ² s).....		
	Behaviour of the equipment during the test		N/A
	Behaviour of the equipment after the test:		
	TSE contacts shall close and open by their normal means. No contact welding.		N/A
	No melting of the fuse in the detection circuit		N/A
	No breakage of the TSE to the extent that the integrity of the mounting of live parts is impaired		N/A
	Enclosed TSE: The door shall be prevented by its latching means, without additional locking means, from being blown open, but deformation of the door alone is not considered to constitute a failure, provided the requirements of degree of protection IP2X are met.		N/A
9.2.5.4.5	Verification of overload releases		
	The operation of overload releases shall be verified at 2,5 times the value of their current setting on each pole separately.		
	The operating time shall not exceed the max. value stated by the manufacturer for twice the current setting at the reference temperature, on a pole singly.		
	Time specified by the manufacturer:		N/A
	- Operation time:(s).....	L1: L2: L3: N:	N/A
9.2.5.5	Verification of dielectric withstand		
	Dielectric verification		
	test voltage (2 x Ue) for 1min (V) (min.1000V AC / 1415V DC)	1000V	P
	No breakdown or flashover		P
	Leakage current		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	test voltage (1,1 x Ue) (V)	253V	P
	Leakage current ≤ 2 mA / pole	<0,1mA	P
9.2.5.6	Verification of temperature-rise		
	Fuse-link details (fuse-combination units only):		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference.....		
	- rated current (A)		
	- power loss (W)		
	- rated breaking capacity (kA).....		
	- conductor cross-section (mm ²)	35mm ²	
	- test current I _e (A).....	100	
	Measured temperature-rise	see appended table 9.2.5.6	P

9.2.6	TEST SEQUENCE IV – CONDITIONAL SHORT-CIRCUIT CURRENT		
	Short-circuit protective device (SCPD) details:		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference.....		
	- rated voltage (V).....		
	- rated current (A)		
	- rated breaking capacity (kA).....		
	SCPD protective short-circuit		
	- test voltage (V)		
	- r.m.s test current (kA)		
	- power factor/time constant		
	SCPD protective short-circuit withstand		
	- max. let-through current: (kA).....		
	- joule integral I ² dt (A ² s).....		
	SCPD protective short-circuit making		
	- max. let-through current: (kA).....		
	- joule integral I ² dt (A ² s).....		
	Behaviour of the equipment during the test		N/A
	Behaviour of the equipment after the test:		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	TSE contacts shall close and open by their normal means. No contact welding.		N/A
	No melting of the fuse in the detection circuit		N/A
	No breakage of the TSE to the extent that the integrity of the mounting of live parts is impaired		N/A
	Enclosed TSE: The door shall be prevented by its latching means, without additional locking means, from being blown open, but deformation of the door alone is not considered to constitute a failure, provided the requirements of degree of protection IP2X are met.		N/A
9.2.6.4	Verification of dielectric withstand		
	Dielectric verification		
	test voltage (2 x Ue) for 1min (V) (min.1000V AC / 1415V DC)		N/A
	No breakdown or flashover		N/A
	Leakage current		
	test voltage (1,1 x Ue) (V)		N/A
	Leakage current ≤ 2 mA / pole		N/A
9.2.6.5	Verification of temperature-rise		
	Fuse-link details (fuse-combination units only):		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference.....		
	- rated current (A)		
	- power loss (W)		
	- rated breaking capacity (kA).....		
	- conductor cross-section (mm ²)		
	- test current I _e (A).....		
	Measured temperature-rise.....		N/A

9.2.7	TEST SEQUENCE V – CRITICAL LOAD CURRENT PERFORMANCE OF EQUIPMENT WITH A DC RATING		
9.2.7.2	Determination of critical load current		
	U _e max (V).....		
	Direction of current flow as specified by manufacturer:		
	The equipment opened 7 times manually or mechanically at the manufacturer's discretion		N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Direction of current flow is not specified by manufacturer:		
	4 operations in the forward direction and 3 in the reverse direction		N/A
	During each cycle, the equipment remain closed for a time sufficient to ensure that the full current is established, but not exceeding 2 s (s).....:		N/A
	Time constant operational performance		N/A
	Number of operating cycles per hour.....:		N/A
	Arcing time during the test (≤ 1 s).....:		N/A
	The test current values shall be: 4 A, 8 A, 16 A, 32 A and 63 A d.c., with ± 10 % tolerance, but not exceeding the rated current.		N/A
	Test currents to find critical d.c. load current and arcing times (ms).....:		N/A
	For each test current, the average arcing time is calculated.		N/A
	If two current flow directions are permitted, the maximum of the two values for this test current is used for further evaluation.		N/A
	If an average arcing time exceeds 1,3 time the value of the average at the rated operational current at the highest rated operational voltage, this is considered a critical current.		N/A
	If no critical value of current is found within these criteria, no further test according to this subclause is required.		N/A
	Forward direction		N/A
	Critical value		N/A
	Maximum mean arcing time		N/A
	Reversed direction		N/A
	Critical value		N/A
	Maximum mean arcing time		N/A
9.2.7.3	Critical load current performance		
	- utilization category.....:		N/A
	- test voltage $U/U_e = 1,0$ (V).....:		N/A
	- critical test current (A).....:		N/A
	- time constant.....:		N/A
	- number of operating cycles per hour.....:		N/A
	- number of operating cycles at I_{crit}:		N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	- on-time (ms)		N/A
	- off-time (s)		N/A
9.2.4.3	Verification of dielectric withstand		
	Dielectric verification		
	test voltage (2 x Ue) for 1min (V) (min.1000V AC / 1415V DC)		N/A
	No breakdown or flashover		N/A
	Leakage current		
	test voltage (1,1 x Ue) (V)		N/A
	Leakage current ≤ 2 mA / pole		N/A
9.2.4.6	Verification of the effectiveness of indication of the main contact position of equipment suitable for isolation		
	Applies for Class PC TSE and Class CB TSE suitable for isolation		N/A
9.2.6 part 1	- actuator type (fig.).....		
9.2.6.2.1	Dependent and independent manual operation		
	- actuating force for opening (N)		
	- test force with blocked main contacts (N).....		
	- used method to keep the contact closed.....		
	During and after the test, open position not indicated		N/A
	Equipment with locking mean, no locking in the open position while test force is applied		N/A
9.2.6.2.2	Dependent power operation		
	- main contacts fixed together in the closed position :		N/A
	- used method to keep the contact closed.....		
	- 110% of the rated supply voltage applied to the equipment (3 times).....		N/A
	During and after the test, open position not indicated		N/A
	Equipment show no damage impairing its normal operation.....		N/A
	Equipment with locking mean, no locking in the open position while test force is applied		N/A
9.2.6.2.3	Independent power operation		
	- main contacts fixed together in the closed position :		N/A
	- used method to keep the contact closed.....		
	- stored energy of the power operator released (3 times).....		N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	During and after the test, open position not indicated		N/A
	Equipment show no damage impairing its normal operation.....		N/A
	Equipment with locking mean, no locking in the open position while test force is applied		N/A
9.2.4.4	Verification of temperature-rise		
	Fuse-link details (fuse-combination units only):		
	- manufacturer's name, trademark or identification mark		
	- manufacturer's model or type reference.....		
	- rated current (A)		
	- power loss (W)		
	- rated breaking capacity (kA).....		
	- conductor cross-section (mm ²)		
	- test current I _e (A).....		
	Measured temperature-rise.....	see appended table 9.2.7.3	N/A

9.2.8	TEST SEQUENCE VI – EMC TESTS VI-1, CDQ6i-100H/4PC		P
9.2.8.1	General		
	Product is classified to be used in environment.....	B	-
9.2.8.2	Immunity		
9.2.8.2.2	Electrostatic discharges		
	Electrostatic discharge immunity test IEC 61000-4-2	air discharge / 8 kV contact discharge / 4 kV	P
	The equipment complies with performance criterion B given in Table 7		P
9.2.8.2.3	Conducted and radiated disturbances induced by radio-frequency fields		
	Conducted disturbances induced by radio-frequency immunity test (150 kHz to 80 MHz) IEC 61000-4-6	10 V for AC/DC power ports 10 V for signal ports	P
	The equipment complies with performance criterion A given in Table 7		P
	Radiated radio-frequency electromagnetic field immunity test (80 MHz to 1 GHz) IEC 61000-4-3	10 V/m	P
	The equipment complies with performance criterion A given in Table 7		P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Radiated radio-frequency electromagnetic field immunity test (1,4 GHz to 6 GHz) IEC 61000-4-3	3 V/m	P
	The equipment complies with performance criterion A given in Table 7		P
9.2.8.2.4	Fast transient bursts		
	Electrical fast transient/burst immunity test IEC 61000-4-4	2 kV / 5 kHz or 100 kHz on AC/DC power ports 1 kV / 5 kHz or 100 kHz on signal ports	P
	The equipment complies with performance criterion B given in Table 7		P
9.2.8.2.5	Surges		
	Surge immunity test (Impulse test 1,2/50 μ s – 8/20 μ s) IEC 61000-4-5	2 kV (line-to-earth) 1 kV (line-to-line)	P
	The equipment complies with performance criterion B given in Table 7		P
9.2.8.2.6	Power frequency magnetic fields		
	Power frequency magnetic field immunity test IEC 61000-4-8	30 A/m	N/A
	The equipment complies with performance criterion A given in Table 7		N/A
9.2.8.2.7	Harmonics		
	Harmonic voltage immunity test IEC 61000-4-13	class 3	P
	The equipment complies with performance criterion A given in Table 7	power and control circuits	P
	The equipment complies with performance criterion B given in Table 7	other functions	P
9.2.8.2.8	Voltage dips and short-time interruptions		
	Voltage dips immunity test (50 Hz/60 Hz) IEC 61000-4-11 for rated operational current $\leq$ 16 A		P
	Voltage dips immunity test (50 Hz/60 Hz) IEC 61000-4-34 for rated operational current $>$ 16 A		P
	Voltage dips immunity test (50 Hz/60 Hz)	0 % during 1 cycle	P
	The equipment complies with performance criterion B given in Table 7		P
	Voltage dips immunity test (50 Hz/60 Hz)	40 % during 10/12 cycles 70 % during 25/30 cycles	P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	The equipment complies with performance criterion C given in Table 7		P
	Short interruptions immunity test (50 Hz/60 Hz) IEC 61000-4-11 for rated operational current ≤ 16 A		P
	Short interruptions immunity test (50 Hz/60 Hz) IEC 61000-4-34 for rated operational current > 16 A		P
	Short interruptions immunity test (50 Hz/60 Hz)	0 % during 250/300 cycles at 0°	P
	The equipment complies with performance criterion C given in Table 7		P
9.2.8.2.9	Performance of the test sample during and after the test		
	After the test, the operating limits of 9.2.3.3 shall be verified.		P
9.2.8.3	Emission		
9.2.8.3.2	Conducted radio-frequency emission tests		
	The equipment does not exceed the levels given in CISPR 11 for equipment Class B, group 1, or for equipment Class A, group 1, as appropriate.		P
9.2.8.3.3	Radiated radio-frequency emission tests		
	The equipment does not exceed the levels given in CISPR 11 for equipment Class B, group 1, or for equipment Class A, group 1, as appropriate.		P

9.2.8	TEST SEQUENCE VI – EMC TESTS VI-2, CDQ6i-100H/4PB		P
9.2.8.1	General		
	Product is classified to be used in environment.....:	B	-
9.2.8.2	Immunity		
9.2.8.2.2	Electrostatic discharges		
	Electrostatic discharge immunity test IEC 61000-4-2	air discharge / 8 kV contact discharge / 4 kV	P
	The equipment complies with performance criterion B given in Table 7		P
9.2.8.2.3	Conducted and radiated disturbances induced by radio-frequency fields		
	Conducted disturbances induced by radio-frequency immunity test (150 kHz to 80 MHz) IEC 61000-4-6	10 V for AC/DC power ports 10 V for signal ports	P
	The equipment complies with performance criterion A given in Table 7		P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Radiated radio-frequency electromagnetic field immunity test (80 MHz to 1 GHz) IEC 61000-4-3	10 V/m	P
	The equipment complies with performance criterion A given in Table 7		P
	Radiated radio-frequency electromagnetic field immunity test (1,4 GHz to 6 GHz) IEC 61000-4-3	3 V/m	P
	The equipment complies with performance criterion A given in Table 7		P
9.2.8.2.4	Fast transient bursts		
	Electrical fast transient/burst immunity test IEC 61000-4-4	2 kV / 5 kHz or 100 kHz on AC/DC power ports 1 kV / 5 kHz or 100 kHz on signal ports	P
	The equipment complies with performance criterion B given in Table 7		P
9.2.8.2.5	Surges		
	Surge immunity test (Impulse test 1,2/50 μ s – 8/20 μ s) IEC 61000-4-5	2 kV (line-to-earth) 1 kV (line-to-line)	P
	The equipment complies with performance criterion B given in Table 7		P
9.2.8.2.6	Power frequency magnetic fields		
	Power frequency magnetic field immunity test IEC 61000-4-8	30 A/m	N/A
	The equipment complies with performance criterion A given in Table 7		N/A
9.2.8.2.7	Harmonics		
	Harmonic voltage immunity test IEC 61000-4-13	class 3	P
	The equipment complies with performance criterion A given in Table 7	power and control circuits	P
	The equipment complies with performance criterion B given in Table 7	other functions	P
9.2.8.2.8	Voltage dips and short-time interruptions		
	Voltage dips immunity test (50 Hz/60 Hz) IEC 61000-4-11 for rated operational current $\leq$ 16 A		P
	Voltage dips immunity test (50 Hz/60 Hz) IEC 61000-4-34 for rated operational current $>$ 16 A		P
	Voltage dips immunity test (50 Hz/60 Hz)	0 % during 1 cycle	P

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	The equipment complies with performance criterion B given in Table 7		P
	Voltage dips immunity test (50 Hz/60 Hz)	40 % during 10/12 cycles 70 % during 25/30 cycles	P
	The equipment complies with performance criterion C given in Table 7		P
	Short interruptions immunity test (50 Hz/60 Hz) IEC 61000-4-11 for rated operational current ≤ 16 A		P
	Short interruptions immunity test (50 Hz/60 Hz) IEC 61000-4-34 for rated operational current > 16 A		P
	Short interruptions immunity test (50 Hz/60 Hz)	0 % during 250/300 cycles at 0°	P
	The equipment complies with performance criterion C given in Table 7		P
9.2.8.2.9	Performance of the test sample during and after the test		
	After the test, the operating limits of 9.2.3.3 shall be verified.		P
9.2.8.3	Emission		
9.2.8.3.2	Conducted radio-frequency emission tests		
	The equipment does not exceed the levels given in CISPR 11 for equipment Class B, group 1, or for equipment Class A, group 1, as appropriate.		P
9.2.8.3.3	Radiated radio-frequency emission tests		
	The equipment does not exceed the levels given in CISPR 11 for equipment Class B, group 1, or for equipment Class A, group 1, as appropriate.		P

9.4	ENVIRONMENTAL TESTS		
	Annex Q of IEC 60947-1:2020 applies.		N/A
	General test conditions and test results.	See Attachment XX	N/A

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict

8.1.6	TABLE: Clearance and creepage distance measurements					P
clearance cl and creepage distance dcr at/of:	Uimp (kV)	Ui (V)	required cl (mm)	cl (mm)	required dcr (mm)	dcr (mm)
Pole and pole	8kV	800V	8	16,6	12,5	16,6
Between live and exposed conductive parts	8kV	800V	8	12,2	12,5	13,4
Supplementary information:						

IEC 60947-6-1

Clause	Requirement + Test	Result - Remark	Verdict
--------	--------------------	-----------------	---------

9.2.3.3.2	TABLE: Operation on loss of supply voltage I-1												
	Ambient: 20,7(°C)												
	Test case									Operating times			
Test No	Rated voltage V	Control supply voltage V	Frequency Hz	Threshold %	Number of phases	N connection Yes/No	Tested phases L1/L2/L3	Time delay(s) min s	Time delay(s) max s	Step Disconnect/ Reconnect	CTT	OTT	Verdict
1	400	230	50	0	4	No	L1	0	90	Disconnect	735ms	3,27s/93,5s	P
2	400	230	50	0	4	No	L2	0	90	Disconnect	739ms	3,26s/93,4s	P
3	400	230	50	0	4	No	L3	0	90	Disconnect	744ms	3,27s/93,5s	P
4	400	230	50	0	4	No	L1	0	90	Reconnect	741ms	3,27s/93,4s	P
5	400	230	50	0	4	No	L2	0	90	Reconnect	742ms	3,28s/93,4s	P
6	400	230	50	0	4	No	L3	0	90	Reconnect	735ms	3,29s/93,3s	P
7	400	230	60	0	4	No	L1	0	90	Disconnect	725ms	3,17s/93,3s	P
8	400	230	60	0	4	No	L2	0	90	Disconnect	731ms	3,29s/93,4s	P
9	400	230	60	0	4	No	L3	0	90	Disconnect	729ms	3,23s/93,1s	P
10	400	230	60	0	4	No	L1	0	90	Reconnect	732ms	3,32s/93,3s	P
11	400	230	60	0	4	No	L2	0	90	Reconnect	719ms	3,21s/93,2s	P
12	400	230	60	0	4	No	L3	0	90	Reconnect	732ms	3,27s/93,0s	P
Supplementary information:													
CTT: Contact Transfer Time (I - II/II – I, including adjustable OFF position time delay)													
OTT: Operating transfer time (including all adjustable time delays; transfer, OFF-position and return)													

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict

9.2.3.3.2 TABLE: Operation on loss of supply voltage I-2													
Ambient: 20,7(°C)													
Test case										Operating times			
Test No	Rated voltage V	Control supply voltage V	Frequency Hz	Threshold %	Number of phases	N connection Yes/No	Tested phases L1/L2/L3	Time delay(s) min s	Time delay(s) max s	Step Disconnect/Reconnect	CTT	OTT	Verdict
1	400	230	50	0	4	No	L1	0	90	Disconnect	751ms	2,23s/92,1s	P
2	400	230	50	0	4	No	L2	0	90	Disconnect	743ms	2,15s/92,3s	P
3	400	230	50	0	4	No	L3	0	90	Disconnect	745ms	2,21s/92,1s	P
4	400	230	50	0	4	No	L1	0	90	Reconnect	755ms	2,24s/92,3s	P
5	400	230	50	0	4	No	L2	0	90	Reconnect	748ms	2,25s/92,1s	P
6	400	230	50	0	4	No	L3	0	90	Reconnect	742ms	2,19s/92,2s	P
7	400	230	60	0	4	No	L1	0	90	Disconnect	734ms	2,22s/92,2s	P
8	400	230	60	0	4	No	L2	0	90	Disconnect	728ms	2,23s/92,4s	P
9	400	230	60	0	4	No	L3	0	90	Disconnect	742ms	2,19s/92,2s	P
10	400	230	60	0	4	No	L1	0	90	Reconnect	728ms	2,24s/92,1s	P
11	400	230	60	0	4	No	L2	0	90	Reconnect	736ms	2,27s/92,2s	P
12	400	230	60	0	4	No	L3	0	90	Reconnect	731ms	2,16s/92,3s	P
Supplementary information:													
CTT: Contact Transfer Time (I - II/II – I, including adjustable OFF position time delay)													
OTT: Operating transfer time (including all adjustable time delays; transfer, OFF-position and return)													

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict

9.2.3.3.2	TABLE: Operation on loss of supply voltage I-3												
	Ambient: 20,7(°C)												
	Test case									Operating times			
Test No	Rated voltage V	Control supply voltage V	Frequency Hz	Threshold %	Number of phases	N connection Yes/No	Tested phases L1/L2/L3	Time delay(s) min s	Time delay(s) max s	Step Disconnect/Reconnect	CTT	OTT	Verdict
1	230	230	50	0	2	No	L	0	90	Disconnect	739ms	1,62s	P
2	230	230	50	0	2	No	N	0	90	Disconnect	723ms	1,63s	P
4	230	230	50	0	2	No	L	0	90	Reconnect	725ms	1,63s	P
5	230	230	50	0	2	No	N	0	90	Reconnect	736ms	1,61s	P
7	230	230	60	0	2	No	L	0	90	Disconnect	726ms	1,64s	P
8	230	230	60	0	2	No	N	0	90	Disconnect	733ms	1,61s	P
10	230	230	60	0	2	No	L	0	90	Reconnect	731ms	1,65s	P
11	230	230	60	0	2	No	N	0	90	Reconnect	727ms	1,59s	P
Supplementary information:													
CTT: Contact Transfer Time (I - II/II – I, including adjustable OFF position time delay)													
OTT: Operating transfer time (including all adjustable time delays; transfer, OFF-position and return)													

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict

9.2.3.3.3	TABLE: Operation on deviation of source I supply characteristics / Voltage limits I-1															
	Ambient: 20,7(°C)															
	Specified accuracy (V): ±10%															
	Test case										Reference value			ATS measurement errors		
Test No	Rated phase voltage V	Frequency Hz	Threshold %	Time delay(s) min s	Number of phases	N connection Yes/No	Limit value V	Tested phases L1/L2/L3	Step Reduce/restore	L1 V	L2 V	L3 V	L1 %	L2 %	L3 %	Verdict
1	230	50	-	0	4	No	187	L1	Reduce	196	N/A	N/A	N/A	N/A	N/A	P
2	230	50	-	0	4	No	187	L2	Reduce	N/A	193	N/A	N/A	N/A	N/A	P
3	230	50	-	0	4	No	187	L3	Reduce	N/A	N/A	195	N/A	N/A	N/A	P
4	230	50	-	0	4	No	263	L1	increase	276	N/A	N/A	N/A	N/A	N/A	P
5	230	50	-	0	4	No	263	L2	increase	N/A	273	N/A	N/A	N/A	N/A	P
6	230	50	-	0	4	No	263	L3	increase	N/A	N/A	278	N/A	N/A	N/A	P
7	230	60	-	0	4	No	187	L1	Reduce	194	N/A	N/A	N/A	N/A	N/A	P
8	230	60	-	0	4	No	187	L2	Reduce	N/A	188	N/A	N/A	N/A	N/A	P
9	230	60	-	0	4	No	187	L3	Reduce	N/A	N/A	192	N/A	N/A	N/A	P
10	230	60	-	0	4	No	263	L1	increase	266	N/A	N/A	N/A	N/A	N/A	P
11	230	60	-	0	4	No	263	L2	increase	N/A	270	N/A	N/A	N/A	N/A	P
12	230	60	-	0	4	No	263	L3	increase	N/A	N/A	269	N/A	N/A	N/A	P
Supplementary information:																

IEC 60947-6-1

Clause	Requirement + Test	Result - Remark	Verdict
--------	--------------------	-----------------	---------

9.2.3.3.3	TABLE: Operation on deviation of source I supply characteristics / Voltage limits I-2															
	Ambient: 20,7(°C)															
	Specified accuracy (V): ±10%															
	Test case										Reference value			ATS measurement errors		
Test No	Rated phase voltage V	Frequency Hz	Threshold %	Time delay(s) min s	Number of phases	N connection Yes/No	Limit value V	Tested phases L1/L2/L3	Step Reduce/restore	L1 V	L2 V	L3 V	L1 %	L2 %	L3 %	Verdict
1	230	50	-	0	4	No	187	L1	Reduce	194	N/A	N/A	N/A	N/A	N/A	P
2	230	50	-	0	4	No	187	L2	Reduce	N/A	195	N/A	N/A	N/A	N/A	P
3	230	50	-	0	4	No	187	L3	Reduce	N/A	N/A	197	N/A	N/A	N/A	P
4	230	50	-	0	4	No	263	L1	increase	272	N/A	N/A	N/A	N/A	N/A	P
5	230	50	-	0	4	No	263	L2	increase	N/A	268	N/A	N/A	N/A	N/A	P
6	230	50	-	0	4	No	263	L3	increase	N/A	N/A	259	N/A	N/A	N/A	P
7	230	60	-	0	4	No	187	L1	Reduce	194	N/A	N/A	N/A	N/A	N/A	P
8	230	60	-	0	4	No	187	L2	Reduce	N/A	192	N/A	N/A	N/A	N/A	P
9	230	60	-	0	4	No	187	L3	Reduce	N/A	N/A	188	N/A	N/A	N/A	P
10	230	60	-	0	4	No	263	L1	increase	267	N/A	N/A	N/A	N/A	N/A	P
11	230	60	-	0	4	No	263	L2	increase	N/A	265	N/A	N/A	N/A	N/A	P
12	230	60	-	0	4	No	263	L3	increase	N/A	N/A	271	N/A	N/A	N/A	P
Supplementary information:																

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict

9.2.3.3.3	TABLE: Operation on deviation of source I supply characteristics / Frequency limits I-1																
	Ambient:20,7 (°C)																
	Specified accuracy (f): ±2Hz																
	Test case									Reference value			ATS measurement errors				
Test No	Rated phase voltage V	Frequency Hz	Threshold %	Time delay(s) min s	Number of phases	N connection Yes/No	Limit value Hz	Tested phases L1/L2/L3	Step Reduce/restore	f Hz			f %			Verdict	
1	230	50	-	0	4	No	45	L1	Reduce	45	N/A	N/A	N/A	N/A	N/A	P	
2	230	50	-	0	4	No	45	L2	Reduce	N/A	45	N/A	N/A	N/A	N/A	P	
3	230	50	-	0	4	No	45	L3	Reduce	N/A	N/A	45	N/A	N/A	N/A	P	
4	230	50	-	0	4	No	55	L1	increase	55	N/A	N/A	N/A	N/A	N/A	P	
5	230	50	-	0	4	No	55	L2	increase	N/A	55	N/A	N/A	N/A	N/A	P	
6	230	50	-	0	4	No	55	L3	increase	N/A	N/A	55	N/A	N/A	N/A	P	
7	230	60	-	0	4	No	50	L1	Reduce	50	N/A	N/A	N/A	N/A	N/A	P	
8	230	60	-	0	4	No	50	L2	Reduce	N/A	50	N/A	N/A	N/A	N/A	P	
9	230	60	-	0	4	No	50	L3	Reduce	N/A	N/A	50	N/A	N/A	N/A	P	
10	230	60	-	0	4	No	65	L1	increase	65	N/A	N/A	N/A	N/A	N/A	P	
11	230	60	-	0	4	No	65	L2	increase	N/A	65	N/A	N/A	N/A	N/A	P	
12	230	60	-	0	4	No	65	L3	increase	N/A	N/A	65	N/A	N/A	N/A	P	
Supplementary information:																	

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict

9.2.3.3.4 TABLE: Operation on deviation of source II supply characteristics I-1																		
Ambient: 20,7(°C)																		
Specified accuracy (U): ±10%																		
Specified accuracy (f): ±2Hz																		
Test case										Reference value				ATS measurement errors				Verdict
Test No	Deviation monitoring 1), 2), 3), 4), 5), 6)	Rated phase voltage V	Rated Frequency Hz	Threshold %	Time delay s	Number of phases	N connection Yes/No	Limit value V/Hz	Tested phases L1/L2/L3	L1 V	L2 V	L3 V	f Hz	L1 %	L2 %	L3 %	f %	
1	1)	230	50	-	0	4	No	187V	L1	202	N/A	N/A	N/A	N/A	N/A	N/A	N/A	P
2	1)	230	50	-	0	4	No	187V	L2	N/A	202	N/A	N/A	N/A	N/A	N/A	N/A	P
3	1)	230	50	-	0	4	No	187V	L3	N/A	N/A	202	N/A	N/A	N/A	N/A	N/A	P
4	2)	230	50	-	0	4	No	263V	L1	261	N/A	N/A	N/A	N/A	N/A	N/A	N/A	P
5	2)	230	50	-	0	4	No	263V	L2	N/A	261	N/A	N/A	N/A	N/A	N/A	N/A	P
6	2)	230	50	-	0	4	No	263V	L3	N/A	N/A	261	N/A	N/A	N/A	N/A	N/A	P
7	3)	230	50	-	0	4	No	45Hz	L1	206	N/A	N/A	47	N/A	N/A	N/A	N/A	P
8	3)	230	50	-	0	4	No	45Hz	L2	N/A	206	N/A	47	N/A	N/A	N/A	N/A	P
9	3)	230	50	-	0	4	No	45Hz	L3	N/A	N/A	206	47	N/A	N/A	N/A	N/A	P
10	4)	230	50	-	0	4	No	187V	L1	202	N/A	N/A	47	N/A	N/A	N/A	N/A	P
11	4)	230	50	-	0	4	No	187V	L2	N/A	202	N/A	47	N/A	N/A	N/A	N/A	P
12	4)	230	50	-	0	4	No	187V	L3	N/A	N/A	202	47	N/A	N/A	N/A	N/A	P
13	5)	230	50	-	0	4	No	55Hz	L1	236	N/A	N/A	53	N/A	N/A	N/A	N/A	P
14	5)	230	50	-	0	4	No	55Hz	L2	N/A	236	N/A	53	N/A	N/A	N/A	N/A	P
15	5)	230	50	-	0	4	No	55Hz	L3	N/A	N/A	236	53	N/A	N/A	N/A	N/A	P
16	6)	230	50	-	0	4	No	263V	L1	249	N/A	N/A	53	N/A	N/A	N/A	N/A	P
17	6)	230	50	-	0	4	No	263V	L2	N/A	249	N/A	53	N/A	N/A	N/A	N/A	P

IEC 60947-6-1																		
Clause	Requirement + Test							Result - Remark						Verdict				

18	6)	230	50	-	0	4	No	263V	L3	N/A	N/A	249	53	N/A	N/A	N/A	N/A	P
19	1)	230	60	-	0	4	No	187V	L1	199	N/A	N/A	N/A	N/A	N/A	N/A	N/A	P
20	1)	230	60	-	0	4	No	187V	L2	N/A	199	N/A	N/A	N/A	N/A	N/A	N/A	P
21	1)	230	60	-	0	4	No	187V	L3	N/A	N/A	199	N/A	N/A	N/A	N/A	N/A	P
22	2)	230	60	-	0	4	No	263V	L1	261	N/A	N/A	N/A	N/A	N/A	N/A	N/A	P
23	2)	230	60	-	0	4	No	263V	L2	N/A	261	N/A	N/A	N/A	N/A	N/A	N/A	P
24	2)	230	60	-	0	4	No	263V	L3	N/A	N/A	261	N/A	N/A	N/A	N/A	N/A	P
25	3)	230	60	-	0	4	No	50Hz	L1	206	N/A	N/A	52	N/A	N/A	N/A	N/A	P
26	3)	230	60	-	0	4	No	50Hz	L2	N/A	206	N/A	52	N/A	N/A	N/A	N/A	P
27	3)	230	60	-	0	4	No	50Hz	L3	N/A	N/A	206	52	N/A	N/A	N/A	N/A	P
28	4)	230	60	-	0	4	No	187V	L1	202	N/A	N/A	52	N/A	N/A	N/A	N/A	P
29	4)	230	60	-	0	4	No	187V	L2	N/A	202	N/A	52	N/A	N/A	N/A	N/A	P
30	4)	230	60	-	0	4	No	187V	L3	N/A	N/A	202	52	N/A	N/A	N/A	N/A	P
31	5)	230	60	-	0	4	No	65Hz	L1	236	N/A	N/A	63	N/A	N/A	N/A	N/A	P
32	5)	230	60	-	0	4	No	65Hz	L2	N/A	236	N/A	63	N/A	N/A	N/A	N/A	P
33	5)	230	60	-	0	4	No	65Hz	L3	N/A	N/A	236	63	N/A	N/A	N/A	N/A	P
34	6)	230	60	-	0	4	No	263V	L1	251	N/A	N/A	63	N/A	N/A	N/A	N/A	P
36	6)	230	60	-	0	4	No	263V	L2	N/A	251	N/A	63	N/A	N/A	N/A	N/A	P
36	6)	230	60	-	0	4	No	263V	L3	N/A	N/A	251	63	N/A	N/A	N/A	N/A	P

Supplementary information:

1) clause 9.2.3.3.4 a) increasing the voltage of source II 2) clause 9.2.3.3.4 a) decreasing the voltage of source II

3) clause 9.2.3.3.4 b) 1) 4) clause 9.2.3.3.4 b) 2) 5) clause 9.2.3.3.4 b) 3) 6) clause 9.2.3.3.4 b) 4)

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict

9.2.3.3.4 TABLE: Operation on deviation of source II supply characteristics I-2																		
Ambient: 20,7(°C)																		
Specified accuracy (U): ±10%																		
Specified accuracy (f): -																		
Test case										Reference value				ATS measurement errors				Verdict
Test No	Deviation monitoring 1), 2), 3), 4), 5), 6)	Rated phase voltage V	Rated Frequency Hz	Threshold %	Time delay s	Number of phases	N connection Yes/No	Limit value V/Hz	Tested phases L1/L2/L3	L1 V	L2 V	L3 V	f Hz	L1 %	L2 %	L3 %	f %	
1	1)	230	50	-	0	4	No	187V	L1	202	N/A	N/A	N/A	N/A	N/A	N/A	N/A	P
2	1)	230	50	-	0	4	No	187V	L2	N/A	202	N/A	N/A	N/A	N/A	N/A	N/A	P
3	1)	230	50	-	0	4	No	187V	L3	N/A	N/A	202	N/A	N/A	N/A	N/A	N/A	P
4	2)	230	50	-	0	4	No	263V	L1	254	N/A	N/A	N/A	N/A	N/A	N/A	N/A	P
5	2)	230	50	-	0	4	No	263V	L2	N/A	254	N/A	N/A	N/A	N/A	N/A	N/A	P
6	2)	230	50	-	0	4	No	263V	L3	N/A	N/A	254	N/A	N/A	N/A	N/A	N/A	P
19	1)	230	60	-	0	4	No	187V	L1	203	N/A	N/A	N/A	N/A	N/A	N/A	N/A	P
20	1)	230	60	-	0	4	No	187V	L2	N/A	203	N/A	N/A	N/A	N/A	N/A	N/A	P
21	1)	230	60	-	0	4	No	187V	L3	N/A	N/A	203	N/A	N/A	N/A	N/A	N/A	P
22	2)	230	60	-	0	4	No	263V	L1	252	N/A	N/A	N/A	N/A	N/A	N/A	N/A	P
23	2)	230	60	-	0	4	No	263V	L2	N/A	252	N/A	N/A	N/A	N/A	N/A	N/A	P
24	2)	230	60	-	0	4	No	263V	L3	N/A	N/A	252	N/A	N/A	N/A	N/A	N/A	P
Supplementary information:																		
1) clause 9.2.3.3.4 a) increasing the voltage of source II 2) clause 9.2.3.3.4 a) decreasing the voltage of source II																		
3) clause 9.2.3.3.4 b) 1) 4) clause 9.2.3.3.4 b) 2) 5) clause 9.2.3.3.4 b) 3) 6) clause 9.2.3.3.4 b) 4)																		

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
9.2.3.5	TABLE: Temperature-rise		P
	Test sample :	I-1	—
	Main circuit / Auxiliary circuit	Position I	—
	Ambient (°C) :	28,3 °C	—
	I_{the} / I_{th} / I_e (A)	100A	—
	Test voltage (V)	-	—
Thermocouple Locations		dT (K) measured	dT (K) required
Terminal Line A		56	65
Terminal Line B		57	65
Terminal Line C		56	65
Terminal Line N		55	65
Terminal Load A		56	65
Terminal Load B		58	65
Terminal Load C		57	65
Terminal Load N		57	65
Handle		3	25
Cover		16	40
Base		19	50
Supplementary information:			

9.2.3.5	TABLE: Temperature-rise		P
	Test sample :	I-2	—
	Main circuit / Auxiliary circuit	Position I	—
	Ambient (°C) :	24,3 °C	—
	I_{the} / I_{th} / I_e (A)	100A	—
	Test voltage (V)	-	—
Thermocouple Locations		dT (K) measured	dT (K) required
Terminal Line A		56	65
Terminal Line B		57	65
Terminal Line C		56	65
Terminal Line N		55	65
Terminal Load A		54	65
Terminal Load B		55	65

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
Terminal Load C	52	65	
Terminal Load N	54	65	
Handle	3	25	
Cover	16	40	
Base	19	50	
Supplementary information:			

9.2.3.5	TABLE: Temperature-rise		P
	Test sample..... :	I-3	—
	Main circuit / Auxiliary circuit	Position I	—
	Ambient (°C)..... :	24,3 °C	—
	I _{the} / I _{th} / I _e (A)	100A	—
	Test voltage (V)	-	—
Thermocouple Locations		dT (K) measured	dT (K) required
Terminal Line L		56	65
Terminal Line N		55	65
Terminal Load L		56	65
Terminal Load N		57	65
Handle		3	25
Cover		16	40
Base		19	50
Supplementary information:			

9.2.3.6 a)	TABLE: Verification of impulse withstand voltage		P
Test voltage applied between:		Test voltage U _{imp} (kV)	Breakdown / flashover (Yes/No)
Between the line and load terminals of the equipment with the contacts in the open position		12,3	No
Between all the terminals of the main circuit connected together (including the control and auxiliary circuit connected to the main circuit) and the enclosure or mounting plate		9,8	No
Between each pole of the main circuit and the other poles connected together and to the enclosure or mounting plate		9,8	No

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Between all terminals of source I connected together, and all terminals of source II connected together, once with the TSE in position I and once with the TSE in position II	9,8	No
	In the "OFF" position, with the test voltage applied across the poles of the main circuit, the line terminals of source I and source II being connected together and the load terminals being connected together	9,8	No
	Between each control and auxiliary circuit not normally connected to the main circuit and the main circuit and the other circuits connected together	2,95	No
	Between each control and auxiliary circuit not normally connected to the main circuit and the main circuit and the exposed conductive parts and the enclosure or mounting plate connected together	2,95	No
Supplementary information:			

9.2.3.6 b)	TABLE: Power-frequency or DC withstand verification		P
Test voltage applied between:		Test voltage (V)	Breakdown / flashover (Yes/No)
Between the line and load terminals of the equipment with the contacts in the open position		AC2000V	No
Between all the terminals of the main circuit connected together (including the control and auxiliary circuit connected to the main circuit) and the enclosure or mounting plate		AC2000V	No
Between each pole of the main circuit and the other poles connected together and to the enclosure or mounting plate		AC2000V	No
Between all terminals of source I connected together, and all terminals of source II connected together, once with the TSE in position I and once with the TSE in position II		AC2000V	No
In the "OFF" position, with the test voltage applied across the poles of the main circuit, the line terminals of source I and source II being connected together and the load terminals being connected together		AC2000V	No
Between each control and auxiliary circuit not normally connected to the main circuit and the main circuit and the other circuits connected together		AC1500V	No
Between each control and auxiliary circuit not normally connected to the main circuit and the main circuit and the exposed conductive parts and the enclosure or mounting plate connected together		AC1500V	No
Supplementary information:			

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
9.2.4.4	TABLE: Temperature-rise		P
	Test sample :	II-1	—
	Main circuit / Auxiliary circuit	Position I	—
	Ambient (°C) :	25,3 °C	—
	I_{the} / I_{th} / I_e (A)	100A	—
	Test voltage (V)	-	—
Thermocouple Locations		dT (K) measured	dT (K) required
Terminal Line A		63	80
Terminal Line B		65	80
Terminal Line C		66	80
Terminal Line N		64	80
Terminal Load A		63	80
Terminal Load B		64	80
Terminal Load C		65	80
Terminal Load N		60	80
Handle		3	35
Cover		13	50
Base		18	60
Supplementary information:			

9.2.4.4	TABLE: Temperature-rise		P
	Test sample :	II-2	—
	Main circuit / Auxiliary circuit	Position I	—
	Ambient (°C) :	25,1 °C	—
	I_{the} / I_{th} / I_e (A)	100A	—
	Test voltage (V)	-	—
Thermocouple Locations		dT (K) measured	dT (K) required
Terminal Line A		63	80
Terminal Line B		65	80
Terminal Line C		66	80
Terminal Line N		61	80
Terminal Load A		63	80
Terminal Load B		64	80
Terminal Load C		65	80

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
Terminal Load N	60	80	
Handle	3	35	
Cover	13	50	
Base	20	60	
Supplementary information:			

9.2.4.4	TABLE: Temperature-rise		P
	Test sample	II-3	—
	Main circuit / Auxiliary circuit	Position I	—
	Ambient (°C)	18,6 °C	—
	I _{the} / I _{th} / I _e (A)	100A	—
	Test voltage (V)	-	—
Thermocouple Locations		dT (K) measured	dT (K) required
Terminal Line L		63	80
Terminal Line N		61	80
Terminal Load L		65	80
Terminal Load N		63	80
Handle		4	35
Cover		14	50
Base		20	60
Supplementary information:			

9.2.5.6	TABLE: Temperature-rise		P
	Test sample	III-1	—
	Main circuit / Auxiliary circuit	Position I	—
	Ambient (°C)	24,6 °C	—
	I _{the} / I _{th} / I _e (A)	100A	—
	Test voltage (V)	-	—
Thermocouple Locations		dT (K) measured	dT (K) required
Terminal Line A		61	80
Terminal Line B		63	80
Terminal Line C		64	80
Terminal Line N		58	80

IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
Terminal Load A	62	80	
Terminal Load B	64	80	
Terminal Load C	65	80	
Terminal Load N	61	80	
Handle	6	35	
Cover	18	50	
Base	15	60	
Supplementary information:			

9.2.5.6	TABLE: Temperature-rise		P
	Test sample..... :	III-2	—
	Main circuit / Auxiliary circuit	Position I	—
	Ambient (°C)..... :	24,2 °C	—
	I _{the} / I _{th} / I _e (A)	100A	—
	Test voltage (V)	-	—
Thermocouple Locations		dT (K) measured	dT (K) required
Terminal Line A		64	80
Terminal Line B		67	80
Terminal Line C		68	80
Terminal Line N		62	80
Terminal Load A		66	80
Terminal Load B		68	80
Terminal Load C		69	80
Terminal Load N		63	80
Handle		3	35
Cover		19	50
Base		17	60
Supplementary information:			



9.2.5.6	TABLE: Temperature-rise		P
	Test sample..... :	III-3	—
	Main circuit / Auxiliary circuit	Position I	—
	Ambient (°C)..... :	26,3 °C	—
	I _{the} / I _{th} / I _e (A)	100A	—



IEC 60947-6-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Test voltage (V)	-	—
Thermocouple Locations		dT (K) measured	dT (K) required
Terminal Line L		58	80
Terminal Line N		60	80
Terminal Load L		62	80
Terminal Load N		64	80
Handle		3	35
Cover		17	50
Base		14	60
Supplementary information:			

9.2.7.3	TABLE: Temperature-rise		
	Test sample		—
	Main circuit / Auxiliary circuit		—
	Ambient (°C)		—
	I_{the} / I_{th} / I_e (A)		—
	Test voltage (V)		—
Thermocouple Locations		dT (K) measured	dT (K) required
Supplementary information:			


Attachment 1 Photo documentation

Outer construction of CDQ6i-100H/2PC

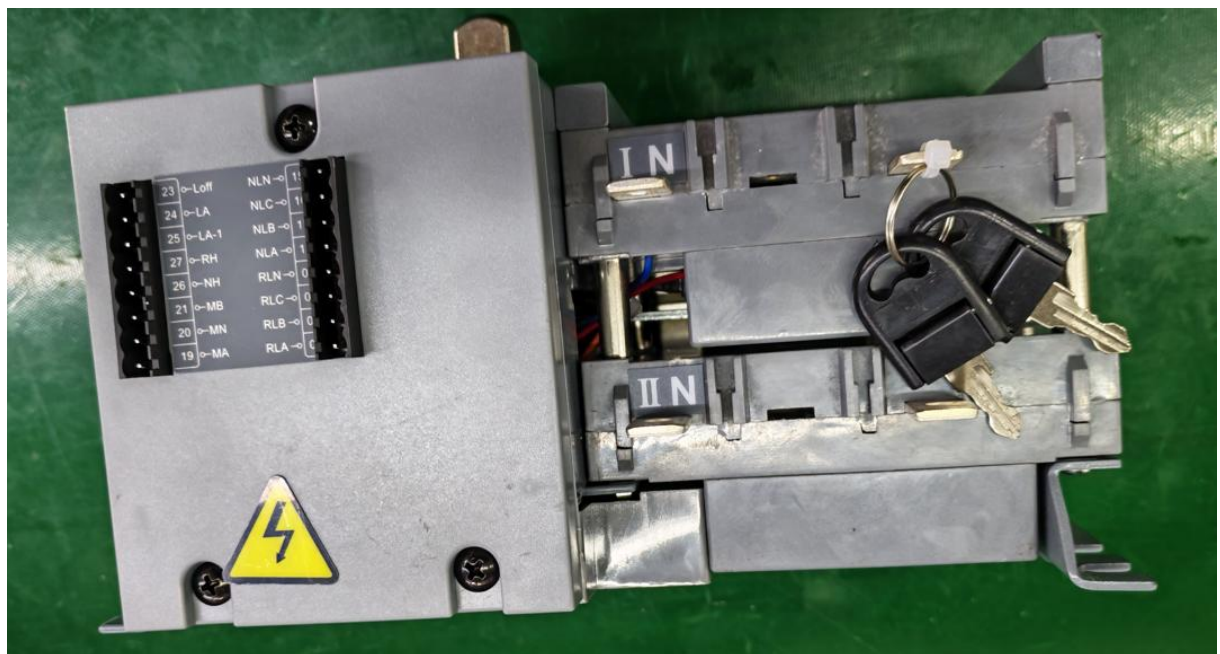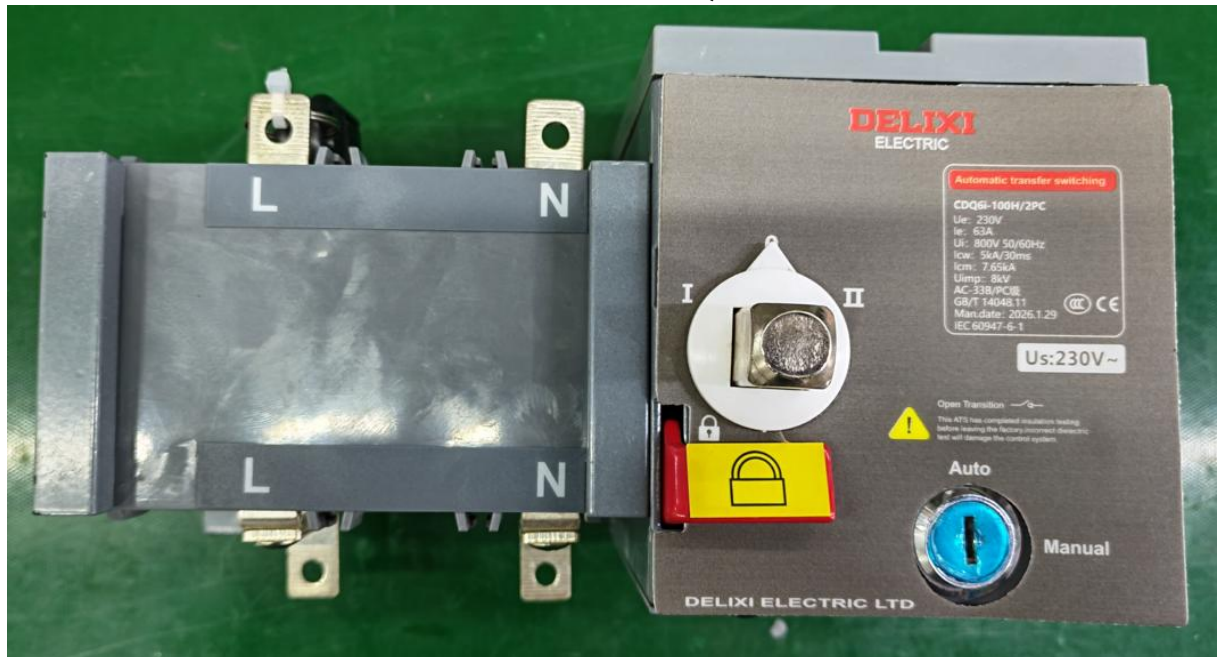


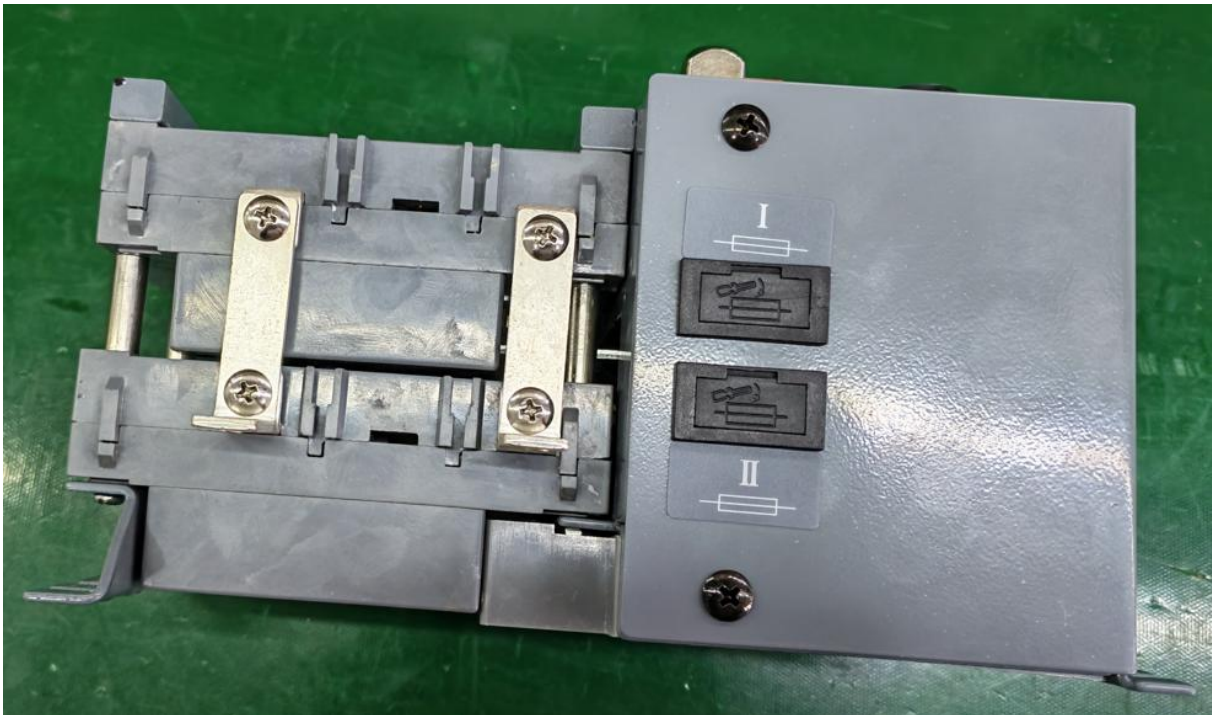
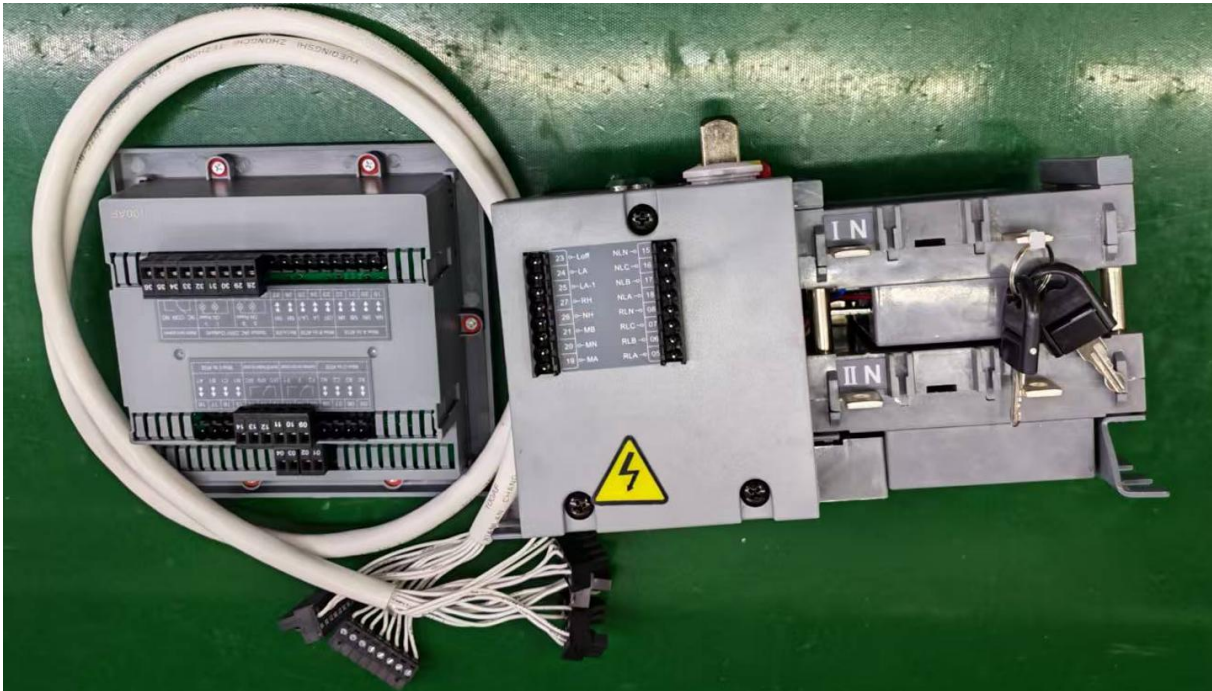


Outer construction of CDQ6i-100N/3PBD

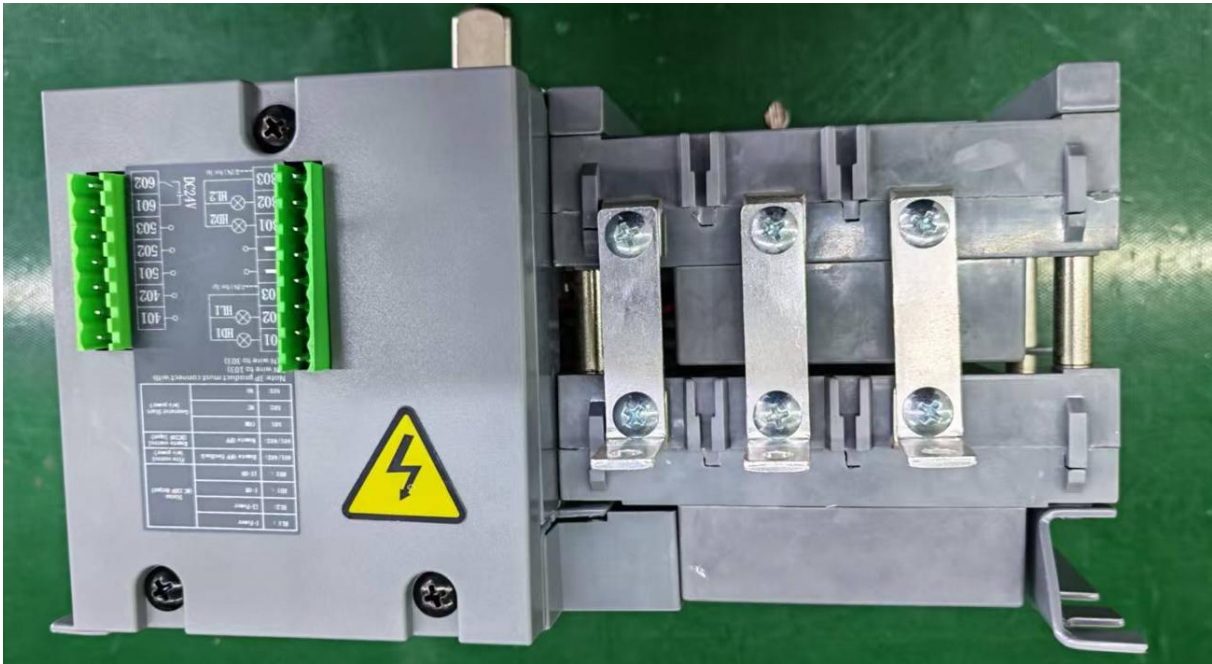

Outer construction of CDQ6i-100H/4P

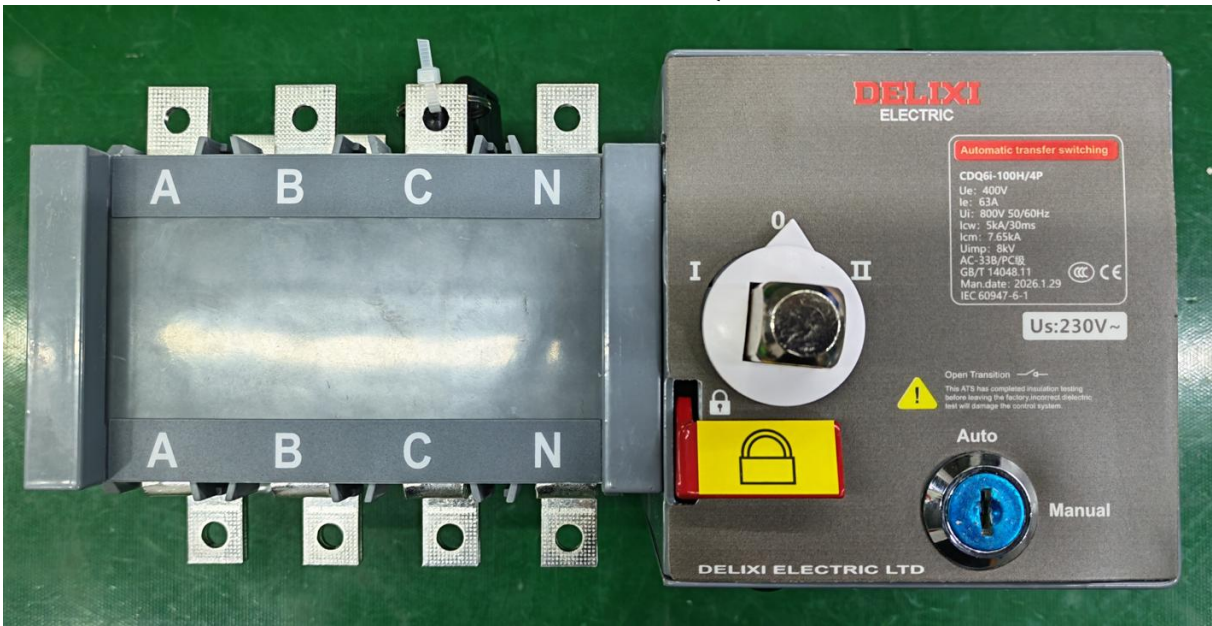

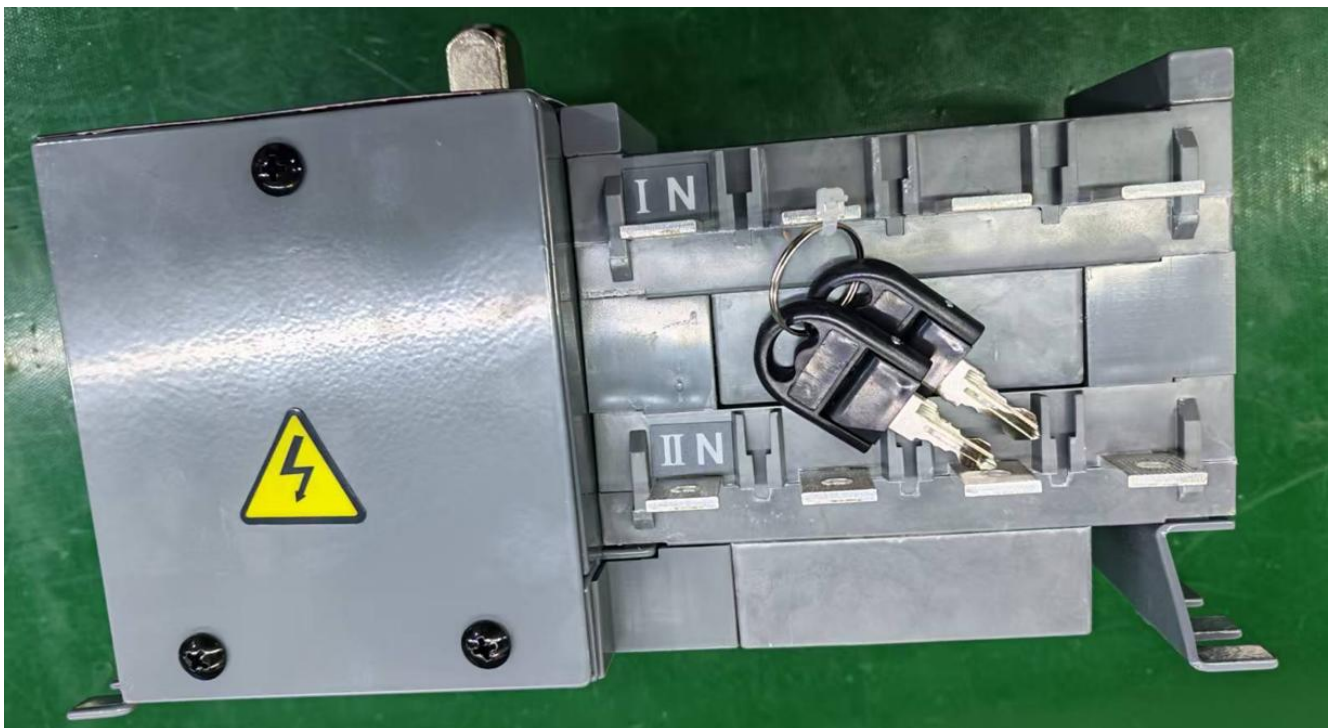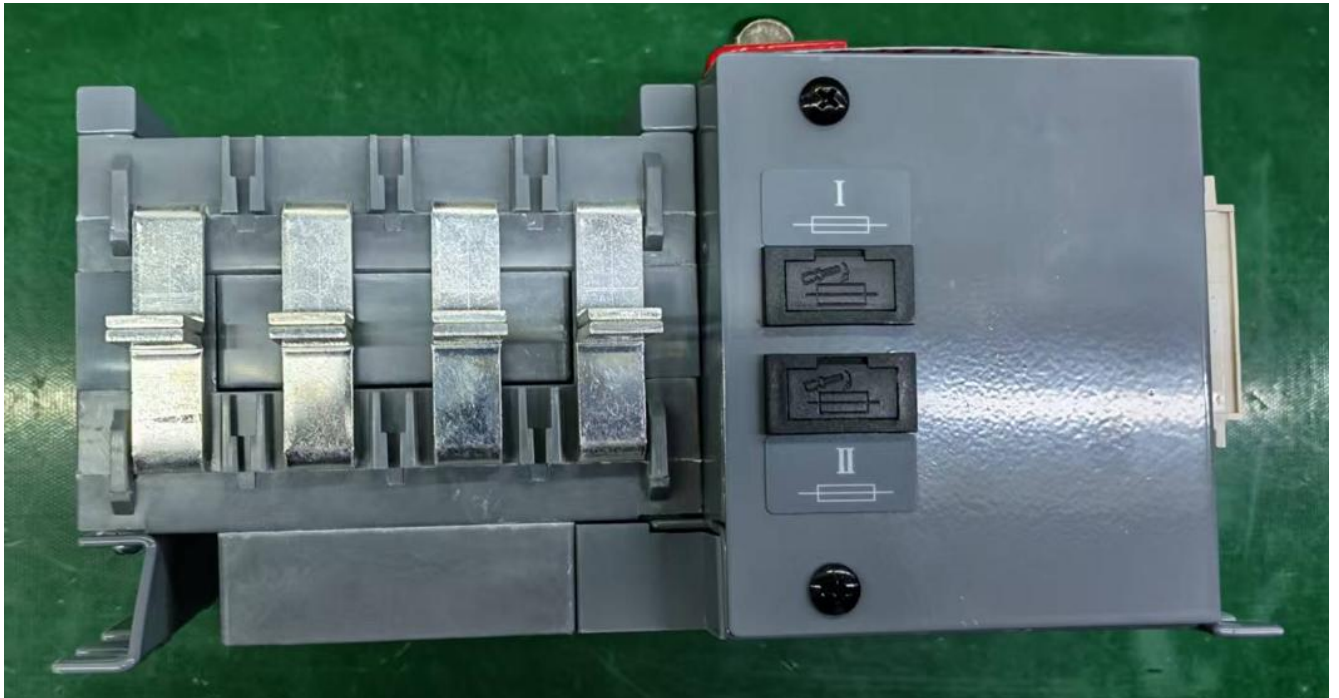

End